

**ENERGY SYSTEMS GROUP
ENVIRONMENTAL MONITORING
AND
FACILITY EFFLUENT
ANNUAL REPORT
1983**




Rockwell International

Energy Systems Group

**ENERGY SYSTEMS GROUP
ENVIRONMENTAL MONITORING
AND
FACILITY EFFLUENT
ANNUAL REPORT
1983**

**BY
J. D. MOORE**

APPROVED:



**R. J. TUTTLE
Manager
Radiation and
Nuclear Safety**



Rockwell International

**Energy Systems Group
8900 De Soto Avenue
Canoga Park, California 91034**

ISSUED: MARCH 1984

CONTENTS

	Page
Abstract.....	7
I. Introduction.....	9
II. Environmental Monitoring Summary Results.....	17
A. Radioactive Materials — 1983.....	17
B. Nonradioactive Materials — 1983.....	28
III. Environmental Monitoring Program.....	31
A. General Description.....	31
B. Sampling and Sample Preparation.....	31
1. Soil.....	31
2. Vegetation.....	38
3. Water.....	39
4. Ambient Air.....	39
C. Counting and Calibration.....	41
D. Nonradioactive Materials.....	42
IV. Effluent Monitoring Program.....	45
A. Treatment and Handling.....	45
B. Energy Systems Group Facility Descriptions.....	47
1. De Soto Site.....	47
2. Santa Susana Field Laboratories Site.....	49
C. Estimation of General Population Dose Attributable to ESG Operations — 1983.....	50
Appendices	
A. Comparison of Environmental Radioactivity Data for 1983 with Previous Years.....	59
B. Environmental Monitoring Program Quality Control.....	65
C. California Regional Water Quality Control Board Criteria for Discharging Nonradioactive Constituents from Rocketdyne Division, SSFL.....	67
D. References.....	69
E. External Distribution.....	69

TABLES

	Page
1-A. Soil Radioactivity Data — 1983.....	18
1-B. Soil Plutonium Radioactivity Data — 1983.....	18
2. Vegetation Radioactivity Data — 1983.....	19
3. Domestic Water Radioactivity Data — 1983.....	20
4. Bell Creek and Rocketdyne Site Retention Pond Radioactivity Data — 1983.....	21
5. Ambient Air Radioactivity Data — 1983.....	22
6-A. De Soto and SSFL Sites — Ambient Radiation Dosimetry Data — 1983...	26
6-B. Do Soto and SSFL Sites — State of California Ambient Radiation Dosimetry Data — 1983.....	27
7. Nonradioactive Constituents in Wastewater Discharged to Unrestricted Areas — 1983.....	29
8. Sample Station Locations.....	35
9. Minimum Radioactivity Detection Levels (MDLs).....	41
10. Atmospheric Emissions to Unrestricted Areas — 1983.....	46
11. Liquid Effluent Discharged to Sanitary Sewer — 1983.....	48
12. De Soto Site Demography.....	52
13. Santa Susana Field Laboratories Site Demography.....	53
14. Maximum Downwind Plume Centerline Concentrations of Atmospheric Emissions — 1983.....	54
15. Maximum Individual Exposure — 1983.....	55
16. Population Dose Estimates for Atmospheric Emissions from the De Soto Facility — 1983.....	56
17. Population Dose Estimates for Atmospheric Emissions from SSFL Facilities — 1983.....	57
A-1. Soil Radioactivity Data — 1964 Through 1983.....	59
A-2. Vegetation Radioactivity Data — 1964 Through 1983.....	60
A-3. SSFL Site Domestic Water Radioactivity Data — 1964 Through 1983....	61
A-4. Bell Creek and Rocketdyne Division Retention Pond Radioactivity Data — 1966 Through 1983.....	62
A-5. Ambient Air Radioactivity Concentration Data — 1964 Through 1983...	63
C-1. NPDES No. CA00-01309, Effective 27 September 1976.....	66

FIGURES

	Page
1. Energy Systems Group – De Soto Site.....	10
2. Energy Systems Group – Santa Susana Field Laboratories Site.....	11
3. Map of Santa Susana Field Laboratories Site Facilities.....	12
4. Map of General Los Angeles Area.....	14
5. Map of Canoga Park, Simi Valley, Agoura, and Calabasas Sampling Stations.....	32
6. Map of De Soto Site and Vicinity Sampling Stations.....	33
7. Map of Santa Susana Field Laboratories Site Sampling Stations.....	34
8. Weekly, Monthly, and Annual Averaged Long-Lived Airborne Radio- activity at the De Soto and Santa Susana Field Laboratories Sites – 1983.....	40

ABSTRACT

Environmental and facility effluent radioactivity monitoring at the Energy Systems Group (ESG) of Rockwell International (California operations) is performed by the Radiation and Nuclear Safety Group of the Health, Safety and Radiation Services Department. Soil, vegetation, and surface water are routinely sampled to a distance of 10 miles from ESG sites. Continuous ambient air sampling and direct radiation monitoring by thermoluminescent dosimetry are performed at several onsite and offsite locations for measuring airborne radioactivity concentrations and site ambient radiation levels. Radioactivity in emissions discharged to the atmosphere from ESG facilities is continuously sampled and monitored to ensure that amounts released to unrestricted areas are within appropriate limits and to identify processes that may require additional engineering safeguards to minimize radioactivity in such discharges. In addition, selected nonradioactive chemical constituent concentrations in surface water discharged to unrestricted areas are determined. This report summarizes and discusses monitoring results for 1983.

The results of this environmental monitoring indicate that there are no significant sources of unnatural radioactive material in the vicinity of the ESG sites. Additionally, the similarity between onsite and offsite results further indicates that the contribution to general environmental radioactivity due to operations of ESG is essentially nonexistent.

The environmental radioactivity reported herein is attributed to natural sources and to fallout of radioactive material from past atmospheric testing of nuclear devices.

I. INTRODUCTION

The Energy Systems Group (ESG) of Rockwell International Corporation has been engaged in nuclear energy research and development since 1946. ESG is currently working on the design, development, fabrication, and testing of components and systems for central station power plants, on the decladding of irradiated nuclear fuel, and on the Decontamination and Disposition of Facilities (D&D) program. Other programs include the development and fabrication of systems for stack gas SO₂ control, production of gaseous and liquid fuels from coal, and solar energy development.

The administrative and scientific research facilities (Figure 1) are located at the ESG De Soto site in Canoga Park, California, approximately 23 miles northwest of downtown Los Angeles. The level site, typical of the San Fernando Valley floor, is at an altitude of 875 ft above sea level. Certain nuclear programs, under licenses issued by the Nuclear Regulatory Commission (NRC) and the State of California, are conducted here. These include (1) the former Building 001 uranium fuel element fabrication facility, which was decommissioned and dismantled during 1983, and (2) Building 004 analytical chemistry laboratories and gamma irradiation facility. The 290-acre ESG Santa Susana Field Laboratories (SSFL) site (Figure 2) is located in the Simi Hills of Ventura County, approximately 30 miles northwest of downtown Los Angeles. The SSFL site, situated in rugged terrain typical of mountain areas of recent geological age, is underlaid by a bedrock unit called the Chico formation. The site may be described as an irregular plateau sprinkled with outcroppings above the more level patches and with peripheral eroded ravines. Elevations of the site vary from 1650 to 2250 ft above sea level. The surface mantle consists of sand and clay soil on sandstone. Both Department of Energy (DOE) and ESG owned facilities share this site, shown in Figure 3. SSFL also contains facilities in which nuclear operations licensed by NRC and the State are conducted. The licensed facilities include: (1) the Rockwell International Hot Laboratory (RIHL), Building 020; (2) the Nuclear Materials Development Facility (NMDF), Building 055; (3) a former neutron radiography facility containing the defueled L-85 nuclear examination and research reactor, Building 093; and




Hq-94CN

Figure 1. Energy Systems Group – De Soto Site

ESG-84-9

ESG-84-9
11

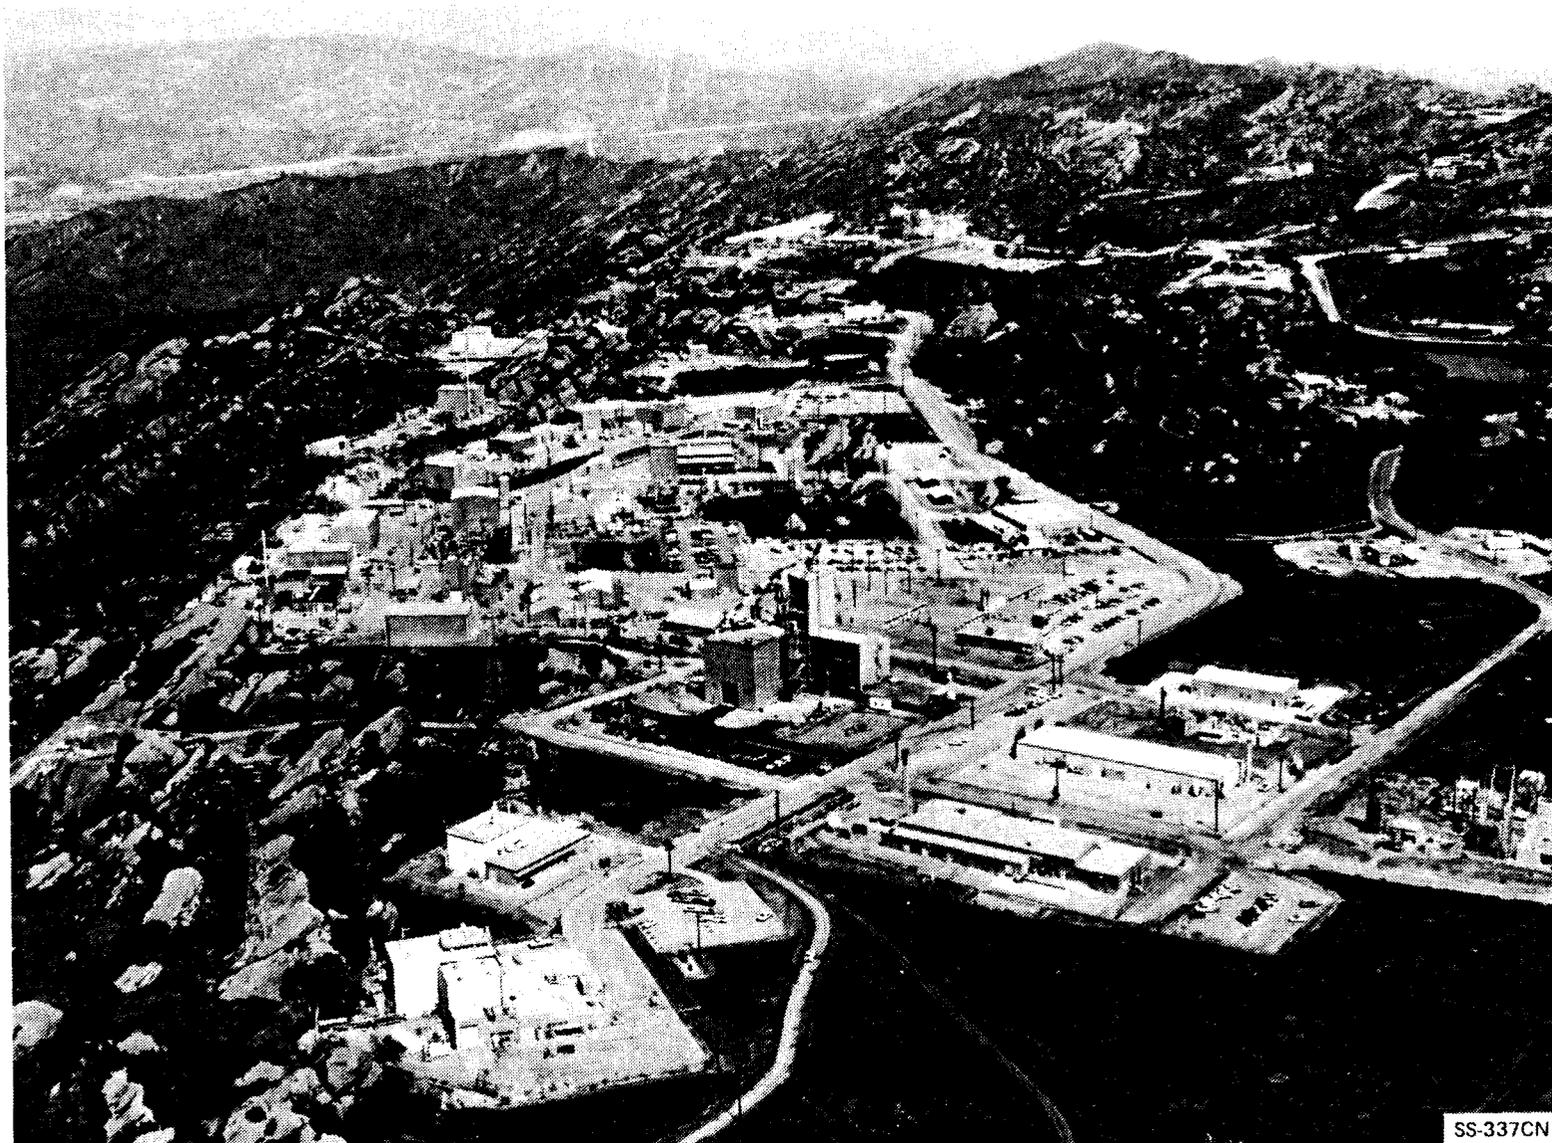

SS-337CN

Figure 2. Energy Systems Group — Santa Susana Field Laboratories Site

(4) several X-ray and radioisotope radiography inspection facilities. The location of these sites in relation to nearby communities is shown in Figure 4.

Also included within the SSFL site is an 82-acre government-optioned area where DOE contract activities are conducted, primarily by the nonnuclear Energy Technology Engineering Center (ETEC). The major operational nuclear installation within the optioned area is the Radioactive Material Disposal Facility (RMDF), Buildings 021 and 022. This facility is used for storage of irradiated fuel and for packaging radioactive wastes generated as a result of the D&D program and fuel decladding operations. Several deactivated nuclear reactor and support facilities, all within the optioned area, are affected by the D&D program. Currently involved are several facilities that had been used for SNAP (Systems for Nuclear Auxiliary Power) reactor test operations and Buildings 024 and 059.

Licensed programs conducted during 1983 included: (1) the operation of the RIHL for nuclear reactor fuel decladding and reactor system component examination and the fabrication of sealed radiation sources and (2) the decommissioning and dismantling of nuclear fuel manufacturing facilities formerly used for the production of experimental and test reactor fuel involving enriched uranium.

The basic policy for the control of radiological and chemical hazards at ESG requires that, through engineering controls, adequate containment of such materials be provided and that, through rigid operational controls, facility effluent releases and external radiation levels be reduced to a minimum. The environmental monitoring program provides a measure of the effectiveness of ESG's safety procedures and of the engineering safeguards incorporated into facility designs. Specific radionuclides in facility effluent or environmental samples are not routinely identified because of the extremely low radioactivity levels normally detected, but would be identified by analytical or radiochemistry techniques if significantly increased radioactivity levels were observed. A relatively small number of radionuclides are involved in these operations.

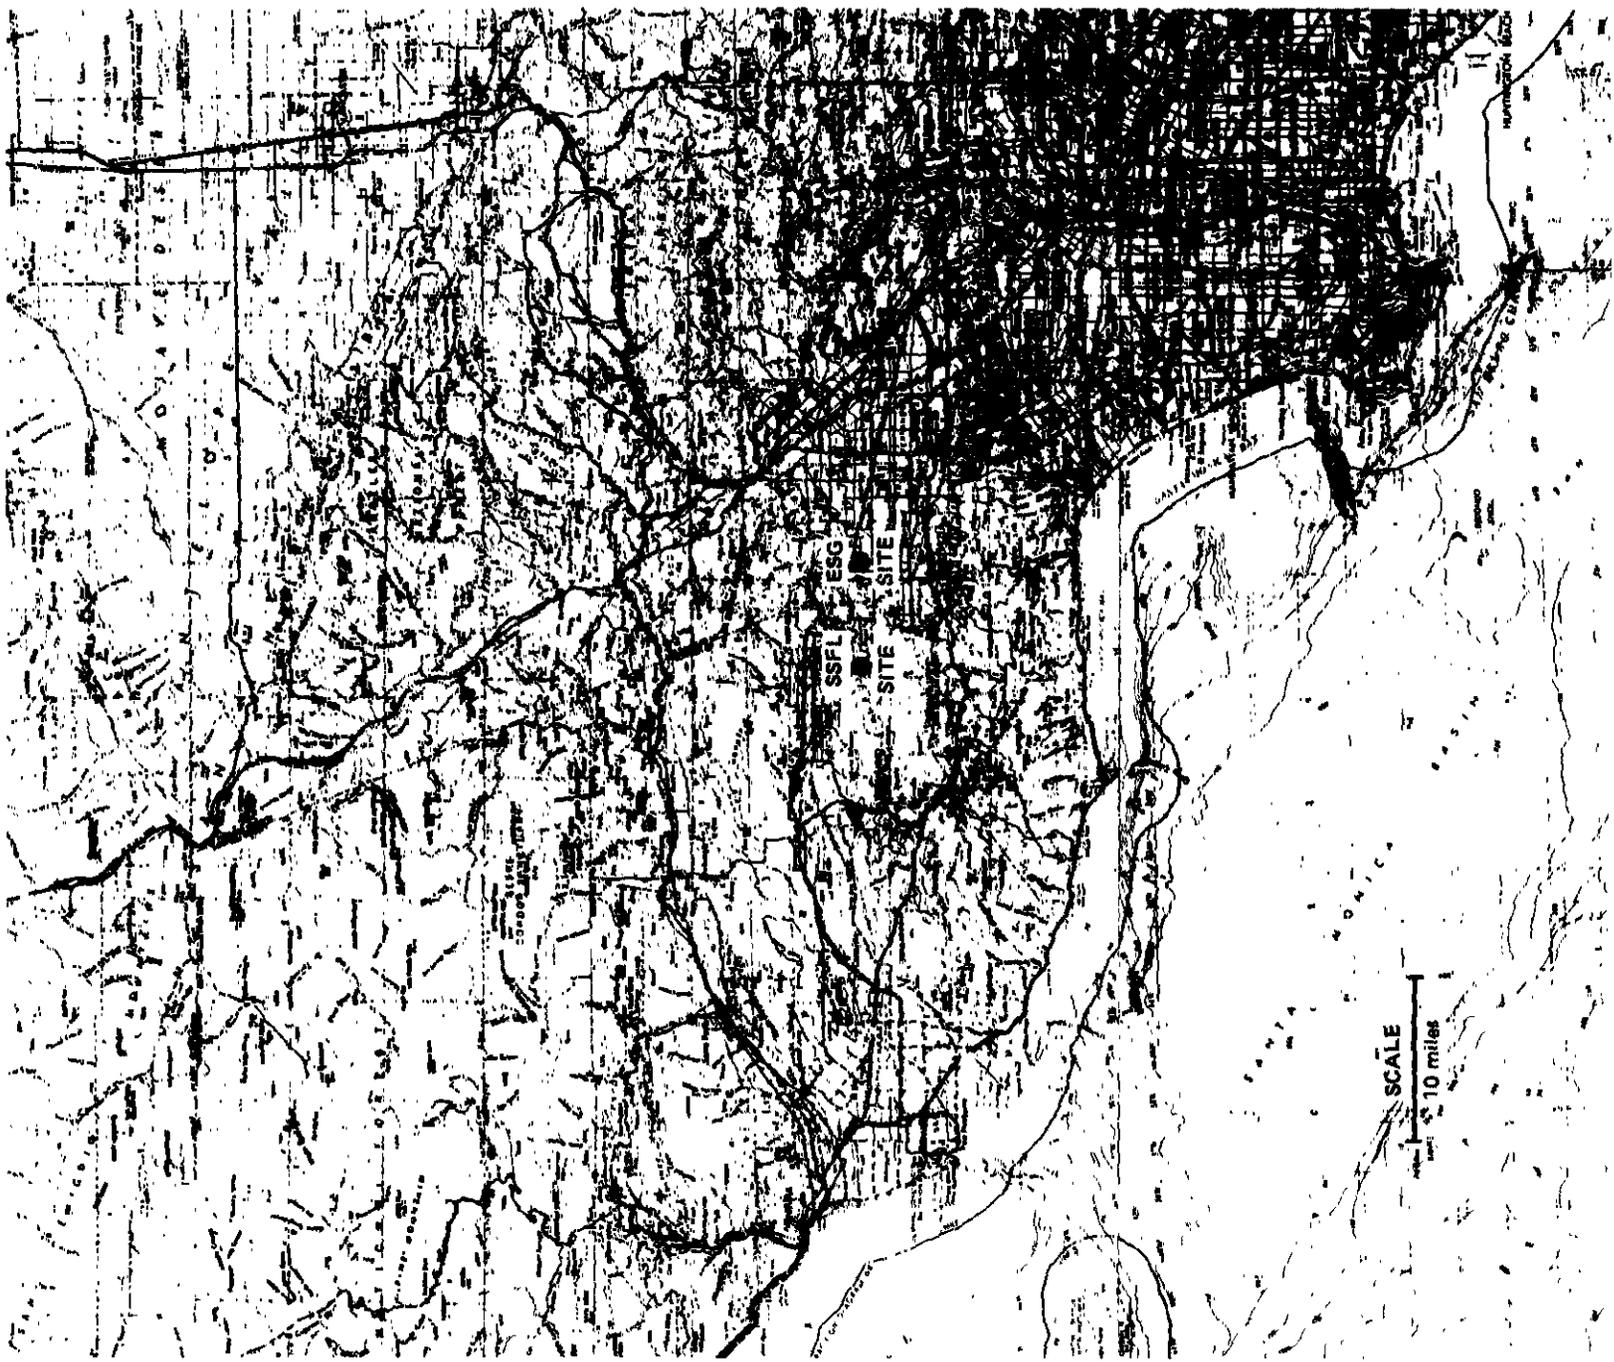


Figure 4. Map of General Los Angeles Area

ESG-84-9

In addition to environmental monitoring, work area air and atmospheric emissions are continuously monitored or sampled, as appropriate. This provides a direct measure of the effectiveness of engineering controls and allows remedial action to be taken before a significant release of hazardous material can occur.

Environmental sampling stations located within the boundaries of ESG sites are referred to as "onsite" stations; those located outside these boundaries but within a 10-mile radius of a site are referred to as "offsite" stations. The De Soto and SSFL sites are sampled monthly to determine the concentration of radioactivity in typical surface soil, native vegetation, and water. Soil is sampled onsite (SSFL) and offsite semiannually for plutonium analysis. Similar offsite environmental samples, except for plutonium analysis, are obtained quarterly. Continuous onsite and offsite ambient air sampling provides information concerning long-lived airborne particulate radioactivity. Onsite ambient radiation monitoring utilizing thermoluminescent dosimetry (TLD) measures environmental radiation levels at the De Soto and SSFL sites and also at several offsite locations.

Nonradioactive wastes discharged to unrestricted areas are limited to liquids released to sanitary sewage systems and to surface water drainage systems. No intentional releases of any liquid pollutants are made to unrestricted areas. Liquid wastes generated at the De Soto site are discharged into the city sewage system. This effluent is sampled prior to release to determine radioactivity. Sanitary sewage from all DOE and ESG facilities at the SSFL site is treated at an onsite sewage plant. The plant outfall drains into retention pond R-2A, located on the adjoining Rocketdyne Division site. The surface water drainage system of SSFL is composed of catch ponds and open drainage ditches leading to retention pond R-2A. Water from the pond may be reclaimed as industrial process water or released, as necessary, offsite into Bell Creek, a tributary of the Los Angeles River. The pond is monitored at discharge for radioactive and non-radioactive pollutants by Rocketdyne Division as required by the discharge permit issued to Rocketdyne by the California Regional Water Quality Control Board.

This report summarizes environmental monitoring results for 1983. A comparison of 1983 radioactivity results with results from previous years appears in Appendix A.

II. ENVIRONMENTAL MONITORING SUMMARY RESULTS

A. RADIOACTIVE MATERIALS — 1983

The sampling and analytical methods used in the environmental monitoring program for radioactive materials are described in Section III, with a summary of the Environmental Monitoring Quality Control program in Appendix B.

The average radioactivity concentrations in local soil, vegetation, surface water, and ambient air for 1983 are presented in Tables 1 through 5. In calculating the averaged concentration value, all values, including negative values, were averaged. The method of noncensored data averaging, recommended by DOE Order 5484.1, affords a better estimate of the central value and dispersion of the data. All limits of error reported in the tables are for one standard deviation (1σ). In most cases, these show the dispersion of the measured value about the mean.

The maximum radioactivity level detected for a single sample from the annual set is reported because of its significance in indicating the occurrence of a major episode or an area-wide incident of radioactive material deposition. None of the maximum observed values, which, as the tables show, occurred randomly during the year, shows a great increase over the average values beyond natural variability. The ambient air sampling data show no greatly increasing or decreasing trends for most of the year and can be described as generally constant, with some increase in local airborne radioactivity levels occurring during the second and third quarters, with a subsequent decrease toward the end of the year.

The results reported in Tables 1-A and 2 show no significant difference between onsite and offsite samples. Table 1-B shows no significant variation in soil plutonium concentrations for the 1983 sample sets.

TABLE 1-A
SOIL RADIOACTIVITY DATA — 1983

Area	Activity	Number of Samples	Gross Radioactivity ($\mu\text{Ci/g}$)	
			Annual Average Value and Dispersion	Maximum Observed Value ^a and Month Observed
Onsite (monthly)	α	144	$(0.61 \pm 0.19) 10^{-6}$	1.13×10^{-6} (March)
	β	144	$(24.2 \pm 2.0) 10^{-6}$	29.7×10^{-6} (October)
Offsite (quarterly)	α	48	$(0.59 \pm 0.18) 10^{-6}$	1.11×10^{-6} (January)
	β	48	$(23.0 \pm 2.8) 10^{-6}$	27.8×10^{-6} (April)

^aMaximum value observed for single sample.

TABLE 1-B
SOIL PLUTONIUM RADIOACTIVITY DATA — 1983

Sample Location	22 June 1983 Survey Results		7 December 1983 Survey Results	
	Pu^{238} ($\mu\text{Ci/g}$)	$\text{Pu}^{239} + \text{Pu}^{240}$ ($\mu\text{Ci/g}$)	Pu^{238} ($\mu\text{Ci/g}$)	$\text{Pu}^{239} + \text{Pu}^{240}$ ($\mu\text{Ci/g}$)
S-56	$(0.0 \pm 1.7) 10^{-9}$	$(2.6 \pm 3.5) 10^{-9}$	$(1.3 \pm 1.1) 10^{-9}$	$(14.4 \pm 3.9) 10^{-9}$
S-57	$(1.4 \pm 1.9) 10^{-9}$	$(2.4 \pm 2.4) 10^{-9}$	$(0.3 \pm 0.6) 10^{-9}$	$(3.8 \pm 2.2) 10^{-9}$
S-58	$(1.5 \pm 4.3) 10^{-9}$	$(10.6 \pm 8.6) 10^{-9}$	$(0.2 \pm 0.5) 10^{-9}$	$(4.3 \pm 2.1) 10^{-9}$
S-59	$(1.7 \pm 2.2) 10^{-9}$	$(1.1 \pm 2.0) 10^{-9}$	$(0.5 \pm 0.7) 10^{-9}$	$(8.1 \pm 3.0) 10^{-9}$
S-60	$(0.5 \pm 1.5) 10^{-9}$	$(3.2 \pm 2.8) 10^{-9}$	$(0.0 \pm 0.2) 10^{-9}$	$(1.7 \pm 1.0) 10^{-9}$
S-61*	$(0.0 \pm 1.8) 10^{-9}$	$(7.1 \pm 5.3) 10^{-9}$	$(0.3 \pm 0.5) 10^{-9}$	$(6.8 \pm 2.8) 10^{-9}$

* Offsite location

For comparison with the plutonium present as a result of nuclear weapons tests and satellite devices, published data from soil tests in nearby Burbank, California, in 1970-71 show a plutonium concentration of $\sim 2 \times 10^{-9}$ $\mu\text{Ci/g}$ for Pu^{239} plus Pu^{240} and $\sim 0.06 \times 10^{-9}$ $\mu\text{Ci/g}$ for Pu^{238} . The data in Table 1-B show no significant increases relative to the Burbank values. The detected activity is due to a variety of naturally occurring radionuclides and to radioactive fallout resulting from the dispersal of nuclear weapons materials and fission products by atmospheric testing. No atmospheric tests in the northern hemisphere were announced during 1983. Naturally occurring radionuclides include Be^7 , K^{40} , Rb^{87} , Sm^{147} , and the uranium and thorium series (including the noble gas radon and its radioactive daughters). Radioactivity from aged fallout consists primarily of the fission products Sr^{90} - Y^{90} , Cs^{137} , and Pm^{147} , and also U^{234} and Pu^{239} . Gamma spectrometric analysis of composited ambient air samples collected during 1983 detected only the naturally occurring radionuclide Be^7 , plus naturally occurring radionuclides of terrestrial origin such as the uranium and thorium series and K^{40} and also the fission product Cs^{137} .

TABLE 2
VEGETATION RADIOACTIVITY DATA - 1983

Area	Activity	Number of Samples	Gross Radioactivity ($\mu\text{Ci/g}$)			Percent of Samples With Activity < MDL ^b
			Dry Weight	Ash		
			Annual Average Value and Dispersion	Annual Average Value and Dispersion	Maximum Value ^a and Month Observed	
Onsite (monthly)	a	144	(0.04 = 0.04) 10^{-6}	(0.18 = 0.14) 10^{-6}	0.91 $\times 10^{-6}$ (January)	40
	b	144	(29.9 = 9.6) 10^{-6}	(149.3 = 42.4) 10^{-6}	240.8 $\times 10^{-6}$ (May)	0
Offsite (quarterly)	a	48	(0.05 = 0.07) 10^{-6}	(0.24 = 0.28) 10^{-6}	1.51 $\times 10^{-6}$ (January)	38
	b	48	(28.3 = 9.8) 10^{-6}	(142.7 = 47.0) 10^{-6}	226.6 $\times 10^{-6}$ (July)	0

^aMaximum value observed for single sample

^bMinimum detection level: 0.12×10^{-6} $\mu\text{Ci/g}$ alpha; 0.36×10^{-6} $\mu\text{Ci/g}$ beta (ash).

TABLE 3
DOMESTIC WATER RADIOACTIVITY DATA — 1983

Area	Activity	Number of Samples	Gross Radioactivity ($\mu\text{Ci/ml}$)	
			Average Value and Dispersion	Maximum Value ^a and Month Observed
ESG-De Soto (monthly)	α	12	$(0.34 \pm 0.23) 10^{-9}$	0.88×10^{-9} (March)
	β	12	$(3.53 \pm 0.97) 10^{-9}$	5.1×10^{-9} (March)
ESG-SSFL (monthly)	α	24	$(0.12 \pm 0.13) 10^{-9}$	0.41×10^{-9} (July)
	β	24	$(3.00 \pm 0.60) 10^{-9}$	4.45×10^{-9} (October)

^aMaximum value observed for single sample

Domestic water is sampled monthly at De Soto and at two widely separated SSFL site locations. The average domestic water radioactivity concentration for each site is presented in Table 3. Domestic water used at the De Soto site is supplied by the Los Angeles Department of Water and Power. Domestic water used at the SSFL site is obtained from Ventura County Water District No. 17, which also supplies nearby communities, and is distributed on the site by the same piping system previously used when all facility process water was obtained from onsite wells. Two onsite water wells (Wells 5 and 13) were operated during 1983 to reduce the consumption of Ventura County domestic water. The well water proportion in the blend averaged about 42% for the year, for a total well water consumption of about 4.1×10^7 gal. Pressure for the water system is provided by elevated storage tanks.

As discussed earlier, surface waters discharged from SSFL facilities and the sewage plant outfall drain southward into retention pond R-2A on Rocketdyne property. When full, the pond may be drained into Bell Creek, a tributary of

TABLE 4
 BELL CREEK AND ROCKETDYNE SITE RETENTION POND RADIOACTIVITY DATA — 1983

Area (Monthly)	Activity	Number of Samples	Gross Radioactivity Concentration			Percent of Samples with Activity <MDL ^c
			Average Value and Dispersion	Maximum Value ^a and Month Observed	Percent of Guide ^b	
Bell Creek mud no. 54 ($\mu\text{Ci/g}$)	α	12	$(0.54 \pm 0.17) \times 10^{-6}$	0.90×10^{-6} (August)	NA	0
	β	12	$(23.4 \pm 2.5) \times 10^{-6}$	30.0×10^{-6} (August)	NA	0
Pond R-2A mud no. 55 ($\mu\text{Ci/g}$)	α	12	$(0.76 \pm 0.15) \times 10^{-6}$	1.00×10^{-6} (March)	NA	0
	β	12	$(24.4 \pm 1.6) \times 10^{-6}$	27.2×10^{-6} (March)	NA	0
Bell Creek vegetation no. 54 ($\mu\text{Ci/g-ash}$)	α	12	$(0.12 \pm 0.10) \times 10^{-6}$	0.39×10^{-6} (April)	NA	58
	β	12	$(136.2 \pm 31.9) \times 10^{-6}$	175.6×10^{-6} (March)	NA	0
Bell Creek vegetation no. 54 ($\mu\text{Ci/g dry weight}$)	α	12	$(0.02 \pm 0.01) \times 10^{-6}$	0.04×10^{-6} (July)	NA	58
	β	12	$(24.4 \pm 8.9) \times 10^{-6}$	41.8×10^{-6} (June)	NA	0
Bell Creek water no. 16 ($\mu\text{Ci/ml}$)	α	12	$(0.08 \pm 0.12) \times 10^{-9}$	0.39×10^{-9} (December)	d	92
	β	12	$(3.30 \pm 0.6) \times 10^{-9}$	4.2×10^{-9} (August)	c	0
Pond water no. 6 ($\mu\text{Ci/ml}$)	α	12	$(0.12 \pm 0.11) \times 10^{-9}$	0.27×10^{-9} (August)	c	83
	β	12	$(3.57 \pm 0.92) \times 10^{-9}$	4.80×10^{-9} (September)	d	0
SSEI Pond R-2A water no. 12 ($\mu\text{Ci/ml}$)	α	12	$(0.13 \pm 0.12) \times 10^{-9}$	0.35×10^{-9} (December)	d	67
	β	12	$(4.44 \pm 1.84) \times 10^{-9}$	9.15×10^{-9} (August)	d	0

^aMaximum value observed for single sample

^bGuide: 5×10^{-6} $\mu\text{Ci/ml}$ alpha; 3×10^{-7} $\mu\text{Ci/ml}$ beta; 10 CFR 20 Appendix B, CAC 17, DOE Order 5480.1

^cMinimum detection level: 0.23×10^{-9} $\mu\text{Ci/ml}$ alpha; 0.64×10^{-9} $\mu\text{Ci/ml}$ beta

^dNA — not applicable, no Guide value having been established.

^eActivity essentially the same as local domestic supply water.

TABLE 5
 AMBIENT AIR RADIOACTIVITY DATA — 1983

Site Location (Continuous)	Activity	Number of Samples	Average Value and Dispersion	Maximum Value ^a and Date Observed	Percent of Guide ^b	Percent of Samples With Activity < MDL
De Soto Onsite ($\mu\text{Ci/ml}$)	α	644	$(2.4 \pm 3.8) 10^{-15}$	6.0×10^{-14} (08/11)	0.08	88 ^c
	β		$(2.6 \pm 2.1) 10^{-14}$	1.3×10^{-13} (10/19)		18 ^d
SSFL Onsite ($\mu\text{Ci/ml}$)	α	1639	$(0.9 \pm 5.4) 10^{-15}$	2.4×10^{-14} (07/03)	1.5	95 ^c
	β		$(2.3 \pm 1.7) 10^{-14}$	1.8×10^{-13} (08/29)		26 ^d
SSFL sewage treatment plant Offsite ($\mu\text{Ci/ml}$)	α	359	$(1.4 \pm 3.2) 10^{-15}$	2.0×10^{-14} (09/02)	2.3	95 ^c
	β		$(2.5 \pm 1.3) 10^{-14}$	2.8×10^{-13} (10/07)		21 ^d
SSFL Control Center Offsite ($\mu\text{Ci/ml}$)	α	330	$(1.0 \pm 2.5) 10^{-15}$	1.1×10^{-14} (07/25)	1.7	97 ^c
	β		$(2.5 \pm 2.1) 10^{-14}$	1.7×10^{-13} (04/25)		22 ^d

^aMaximum value observed for single sample

^bGuide: De Soto site: $3 \times 10^{-12} \mu\text{Ci/ml}$ alpha, $3 \times 10^{-10} \mu\text{Ci/ml}$ beta, 10 CFR 20 Appendix B. SSFL site: $6 \times 10^{-14} \mu\text{Ci/ml}$ alpha, $3 \times 10^{-11} \mu\text{Ci/ml}$ beta; 10 CFR 20 Appendix B, CAC 17, and DOE Order 5480.1A

^cMDL = $6.4 \times 10^{-15} \mu\text{Ci/ml}$ alpha

^dMDL = $1.3 \times 10^{-14} \mu\text{Ci/ml}$ beta.

the Los Angeles River in the San Fernando Valley, Los Angeles County. Pursuant to the requirements of Los Angeles Regional Water Quality Control Board Resolution 66-49 of 21 September 1966, a sampling station for evaluating environmental radioactivity in Bell Canyon was established in 1966. It is located approximately

2.5 miles downstream from the southern Rockwell International Corporation boundary. Samples, obtained and analyzed monthly, include stream bed mud, vegetation, and water. Average radioactivity concentrations in Rocketdyne and Bell Creek samples are presented in Table 4.

Comparison of the radioactivity concentrations in water from the ponds and from Bell Creek with that of the domestic water supply shows no significant differences in either alpha or beta activity. Similar comparisons between onsite and offsite soil and vegetation samples, and those of Bell Creek show no significant differences.

The SSFL site surface water and the ambient air radioactivity concentration guide values selected for each site are the most restrictive limits for those radionuclides currently in use at ESG facilities. Radioactivity concentration guide values are those concentration limits adopted by DOE, NRC, and the State of California as maximum permissible concentrations (MPCs). The MPC values are dependent on the radionuclide and its behavior as a soluble or an insoluble material. For comparison with results of environmental and effluent monitoring, the lowest MPC value for the various radionuclides present is selected. Accordingly, for SSFL site surface water, the guide values of 5×10^{-6} $\mu\text{Ci/ml}$ alpha activity corresponding to Pu^{239} and 3×10^{-7} $\mu\text{Ci/ml}$ beta activity corresponding to Sr^{90} are appropriate. The corresponding most restrictive guide value for De Soto site wastewater radioactivity discharged to the sanitary sewage system, a controlled area, is 9×10^{-4} $\mu\text{Ci/ml}$ alpha activity corresponding to U^{234} and 1×10^{-3} $\mu\text{Ci/ml}$ beta activity corresponding to Co^{60} . These values are established in 10 CFR 20, California Administrative Code Title 17, and DOE Order 5480.1.

The guide value of 6×10^{-14} $\mu\text{Ci/ml}$ for SSFL site ambient air alpha activity is due to work with unencapsulated plutonium. The value of 3×10^{-11} $\mu\text{Ci/ml}$ for beta activity is due to the presence of Sr^{90} in fission products in irradiated nuclear fuel at the SSFL site. The guide value of 3×10^{-12} $\mu\text{Ci/ml}$ for De Soto ambient air alpha activity is due to work with unencapsulated uranium (including depleted uranium). The guide value of 3×10^{-10} $\mu\text{Ci/ml}$ is for Co^{60} , for which

the ambient air beta activity guide is appropriate since it is the most restrictive limit for beta-emitting radionuclides present at the De Soto site. Guide value percentages are not presented for soil or vegetation data since none have been established.

Ambient air sampling for long-lived particulate alpha and beta radioactivity is performed continuously by automatic sequential samplers located at the De Soto and SSFL sites. Air is drawn through Type A/E glass fiber filter media, which are analyzed for retained long-lived radioactivity after a minimum 120-h decay period that eliminates naturally occurring short-lived particulate radioactivity. The average concentrations of ambient air alpha and beta radioactivity for 1983 are presented for the various sampler locations in Table 5.

Radioactivity levels observed in environmental samples for 1983, reported in Tables 1 through 5, compare closely with levels reported for recent years. Local environmental radioactivity levels, which result primarily from beta-emitting radionuclides and which had shown the effect of fallout during past extensive atmospheric testing of nuclear devices, have decreased and have been generally constant during the past several years. The effects of foreign atmospheric nuclear tests continue to be occasionally observed in daily ambient airborne radioactivity levels. The long-term effects of airborne radioactivity on surface sample radioactivity levels are not discernible for recent years. The continuing relative constancy in environmental radioactivity levels is due primarily to the dominance of naturally occurring radionuclides in the environment and to the longer-life fission product radioactivity from aged fallout.

Site ambient radiation monitoring is performed with thermoluminescent dosimeters. Each dosimeter set uses two calcium fluoride ($\text{CaF}_2:\text{Mn}$) low background, bulb-type chip dosimeters. The dosimeter sets are placed at locations on or near the perimeters of the De Soto and SSFL sites. Each dosimeter, sealed in a light-proof energy compensation shield, is installed in a polyethylene container which is mounted about 1 m above ground at each location. The dosimeters are exchanged and evaluated quarterly. Fifteen onsite TLD monitoring

locations were used during the year. Five additional dosimeter sets, placed at locations up to 10 miles from the ESG sites, are similarly evaluated to determine the local area offsite ambient radiation level, which averaged 13 μ R/h for 1983. The quarterly and annual radiation exposures and the equivalent annual exposure rates monitored at each dosimeter location are presented in Table 6.

The table shows that radiation exposures and equivalent annual exposure rates monitored onsite are nearly identical to levels monitored at five widely separated offsite locations. These data include natural background radiation from cosmic radiation, radionuclides in the soil, radon and thoron in the atmosphere, and radioactive fallout from atmospheric nuclear device tests. Locally, the natural background radiation level as measured by these dosimeters is about 120 mR/year. The small variability observed in the data is attributed to differences in elevation and geologic conditions at the various dosimeter locations. The altitude range for the dosimeter locations is from about 875 ft ASL (above sea level) at the De Soto site to a maximum of about 1900 ft ASL for one of the SSFL dosimeters. When normalized to a specific altitude by adjusting the reported value by an altitude adjustment factor, measured radiation exposures for all locations are essentially identical. The 1983 averaged exposure values adjusted to 1000 ft ASL are 112 ± 7 mR for the De Soto site, 112 ± 9 mR for the SSFL site, and 116 ± 7 mR for the offsite control dosimeters. Since the data for the onsite and offsite locations are nearly identical, no measurable direct radiation dose to the general population or to individuals in uncontrolled areas resulted from ESG operations.

During the 4-year period 1977 through 1980, a steady increase was observed in the TLD readings for all locations. Although the increases were variable from year to year and between locations, averaged over 4 years, the increases were in the range of 14 to 17 mR per year. The values for 1983 show a slight, but not statistically significant, decrease over the previous year's results and continue the downward trend, begun in 1981, toward the earlier observed values. Among DOE-contractor environmental monitoring programs, this apparent increase in radiation readings was observed by only one other contractor; that contractor is also the only other contractor using the $\text{CaF}_2:\text{Mn}$ bulb-type dosimeters that are used at ESG. Thus, the effect appears to be related to this particular type of dosimeter.

TABLE 6-A
DE SOTO AND SSFL SITES — AMBIENT RADIATION
DOSIMETRY DATA — 1983

TLD Location	Quarterly Exposure (mR)				Annual Exposure (mR)	Equivalent Exposure at 1000 ft ASL	
	Q-1	Q-2	Q-3	Q-4		(mR)	(μ R/h)
1. De Soto	29	29	28	27	113	115	13
2. De Soto	28	27	26	25	106	108	12
3. De Soto	28	24	26	25	103	105	12
4. De Soto	32	30	31	30	123	125	14
5. De Soto	28	26	28	24	106	108	12
6. De Soto	31	28	32	28	119	121	14
7. De Soto	27	25	27	24	103	105	12
8. De Soto	31	27	27	24	109	111	13
Mean value	29	27	28	26	110	112	13
1. SSFL	31	a	31	29	121	109	12
2. SSFL	31	32	32	31	126	114	13
3. SSFL	33	32	33	33	131	119	14
4. SSFL	30	32	37	31	130	117	13
5. SSFL	30	30	31	29	120	107	12
6. SSFL	26	27	29	26	108	97	11
7. SSFL	38	34	35	29	136	124	14
Mean value	31	31	33	31	126	112	13
1. Offsite	29	30	31	27	117	120	14
2. Offsite	28	27	28	25	108	106	12
3. Offsite	30	27	27	25	109	111	13
4. Offsite	30	31	33	27	121	119	14
5. Offsite	32	31	32	28	123	124	14
Mean value	30	29	30	26	115	116	13

^aMissing dosimeter; annual exposure based on data for three quarters.

Supplementary measurements of ambient radiation levels are made with a high-pressure ion chamber (HPIC) at each site. The HPIC values for 1983 were equivalent to annual exposures of 99 mR for De Soto and 105 mR for SSFL. Data for the State of California TLDs (LiF), which are placed at eight ESG dosimeter locations, both onsite and offsite, are presented in Table 6-B for 1983. These variations reflect the normal variations in measurements with these devices and are not significant.

TABLE 6-B
DE SOTO AND SSFL SITES - STATE OF CALIFORNIA
AMBIENT RADIATION DOSIMETRY DATA - 1983

TLD Location	Quarterly Exposure (mR)				Annual Exposure (mR)	Equivalent Exposure at 1000 ft ASL	
	Q-1	Q-2	Q-3	Q-4		(mR)	(μ R/h)
2. De Soto	27	16	43	19	105	107	12
4. De Soto	24	13	33	17	87	89	10
8. De Soto	- ^a	39	25	17	108 ^b	110	13
Mean value	26	23	34	18	100	102	12
3. SSFL	34	- ^c	39	22	127 ^b	115	13
6. SSFL	26	22	30	26	104	93	11
7. SSFL	- ^a	- ^c	54	24	156 ^b	144	16
Mean value	30	22	41	24	129	117	13
1. Offsite	22	27	- ^c	19	91 ^b	93	11
5. Offsite	19	18	- ^c	21	77 ^b	78	9
Mean value	21	23	-	20	84	86	10

^aDosimeter location began with second quarter

^bAnnualized value

^cDosimeter damaged during deployment interval

B. NONRADIOACTIVE MATERIALS — 1983

Processed wastewater and most collected surface runoff discharged from the SSFL site flows to retention pond R-2A, operated by Rocketdyne. Water samples from the pond are analyzed for various constituents, as required by the Regional Water Quality Control Board, for each discharge to Bell Canyon. Such discharges are normally done only as a result of excessive rainfall runoff. During rainfall-caused releases, the NPDES permit concentration limits for turbidity and for suspended and settleable solids do not apply. The results of analyses for each discharge for 1983, most of which were rainfall related, are presented in Table 7.

TABLL 7

NONRADIOACTIVE CONSTITUENTS IN WASTEWATER DISCHARGED TO UNRESTRICTED AREAS - 1983
 (Analysis Results for Wastewater Discharged from Pond R-2A to
 Bell Creek on Date Indicated - Sample Station W-12)
 (Sheet 1 of 2)

	January 13		January 19 ^a		January 24 ^a		February 3 ^a		February 17 ^a		February 25 ^a		March 3 ^a		March 14 ^a		March 24 ^a		April 11 ^a	
	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide
Total dissolved solids (mg/l)	552	58.1	218	22.9	151	15.9	234	24.6	377	39.7	328	34.5	124	13.1	358	37.7	210	22.1	511	53.8
Chloride (mg/l)	64	42.7	41	27.3	16	10.7	22	14.7	38	25.3	30	20.0	10	6.7	30	20.0	18	12.0	45	30.0
Sulfate (mg/l)	96	32.0	115	38.3	16	5.3	55	18.3	92	30.7	94	31.3	31	10.3	92	30.7	48	16.0	164	54.7
Suspended solids ^b (mg/l)	1.3	<1.0	50	33.3	79	52.7	38	25.3	15	10.0	31	20.7	31	20.7	120	80.0	72	48	6	4.0
Settleable solids ^b (mg/l)	<0.01	<3.3	<0.1	<33.3	0.1	33.3	<0.1	<33.3	0.2	66.7	0.2	66.7	<0.1	33.3	0.4	133.3	<0.1	<33.3	<0.1	<33.3
BOD ₅ (mg/l)	1.5	2.5	7	11.7	3	5.0	4	6.7	5	8.3	3	5.0	1	1.7	4	6.7	4	6.7	4	6.7
Oil and grease (mg/l)	2.8	18.7	<1	6.7	3	20.0	1	20.0	2	13.3	<1	<6.7	2	13.3	2	13.3	2	13.3	<1	<6.7
Turbidity ^b (TU)	4		33		65		33		9		28		15		11		29		22	
Chromium (mg/l)	0.001	10.0	0.005	50.0	0.014	140.0	0.009	90.0	0.004	40.0	0.001	10.0	0.012	120.0	0.003	30.0	0.006	60.0	<0.001	<10.0
Fluoride (mg/l)	0.5	50.0	0.4	40.0	0.4	40.0	0.3	30.0	0.4	40.0	0.4	40.0	0.3	30.0	0.4	40.0	0.3	30.0	0.5	50.0
Boron (mg/l)	0.2	20.0	<0.2	<20.0	<0.2	<20.0	<0.2	<20.0	0.2	20.0	<0.02	<2.0	<0.2	<20.0	0.2	20.0	<0.2	<20.0	0.4	40.0
Residual chlorine (mg/l)	<0.04	<40.0	<0.04	<40.0	<0.04	<40.0	<0.04	<40.0	<0.04	<40.0	<0.04	<40.0	<0.04	<40.0	<0.04	<40.0	<0.04	<40.0	0.05	50.0
Fecal coliform (MPN/100 ml)	<2	<8.7	<2	<8.7	<2	<8.7	<2	<8.7	<2	<8.7	<2	<8.7	<2	<8.7	<2	<8.7	23	-	2	8.7
Surfactants (NRAS)	0.03	6.0	0.01	2.0	<0.01	<2.0	0.01	2.0	0.02	4.0	0.01	2.0	<0.01	<2.0	0.01	2.0	<0.01	<2.0	0.01	2.0
pH	8.0		8.3		7.7		7.6		7.9		7.8		7.8		7.7		7.7		8.2	
Rainfall (in.)	0		3.43		4.58		2.57		1.28		3.81		9.60		1.45		0.35		0.06	
Estimated rainfall runoff (gal)	0		4.8 x 10 ⁷		5.8 x 10 ⁷		4.0 x 10 ⁷		2.5 x 10 ⁷		5.2 x 10 ⁷		1.2 x 10 ⁸		2.7 x 10 ⁷		2.8 x 10 ⁷		3.8 x 10 ⁶	
Release Volume (gal)	2.5 x 10 ⁶		3.0 x 10 ⁶		3.0 x 10 ⁶		2.3 x 10 ⁶		3.0 x 10 ⁶		2.6 x 10 ⁶		2.3 x 10 ⁶		2.4 x 10 ⁶		2.4 x 10 ⁶		3.2 x 10 ⁶	

ESG-84-9
29

TABLE 7

NONRADIOACTIVE CONSTITUENTS IN WASTEWATER DISCHARGED TO UNRESTRICTED AREAS - 1983
 (Analysis Results for Wastewater Discharged from Pond R-2A to
 Bell Creek on Date Indicated - Sample Station W-12)
 (Sheet 2 of 2)

	April 18 ^a		June 1 ^a		September 29 ^a		October 7 ^a		November 11 ^a		November 28 ^a		December 5 ^a		December 12 ^a		December 26 ^a	
	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide	Result	% of Guide
Total dissolved solids (mg/l)	263	27.7	508	53.5	614	64.6	325	34.2	426	44.8	446	46.9	400	42.1	397	41.8	265	27.9
Chloride (mg/l)	24	16.0	54	36.0	74	49.3	37	24.7	46	30.7	43	28.7	42	28.0	43	28.7	38	25.3
Sulfate (mg/l)	75	25.0	160	53.3	189	63.0	97	32.3	123	41.0	106	35.3	110	36.7	119	39.7	82	27.3
Suspended solids ^b (mg/l)	101	67.3	10	6.7	53	35.3	51	34.0	41	27.3	37	24.7	40	26.7	18	12.0	45	30.0
Settleable solids ^b (mg/l)	0.1	33.3	<0.1	<33.3	0.2	66.7	0.1	33.3	0.2	66.7	0.1	33.3	<0.1	<33.3	<0.1	<33.3	0.1	33.3
BOD ₅ (mg/l)	4	6.7	4	6.7	5	8.3	12	20.0	7	11.7	5	8.3	2	3.3	2	3.3	4	6.7
Oil and grease (mg/l)	2	13.3	4	26.7	<1	<6.7	3	20.0	2	13.3	2	13.3	1.1	7.3	1	6.7	2	13.3
Turbidity ^b (TU)	25	-	4	-	4	-	18	-	20	-	7	-	19	-	13	-	26	-
Chromium (mg/l)	<0.001	<10.0	<0.001	<10.0	0.007	70.0	0.004	40.0	0.004	40.0	0.002	20.0	0.003	30.0	0.001	10.0	0.004	40.0
Fluoride (mg/l)	0.3	30.0	0.5	50.0	0.5	50.0	0.3	30.0	0.4	40.0	0.4	40.0	0.5	50.0	0.5	50.0	0.4	40.0
Boron (mg/l)	0.2	20.0	0.3	30.0	0.3	30.0	0.2	20.0	0.3	30.0	0.5	50.0	0.3	30.0	0.3	30.0	0.1	10.0
Residual chlorine (mg/l)	0.04	40.0	<0.04	<40.0	<0.04	<40.0	<0.04	<40.0	<0.04	<40.0	<0.04	<40.0	0.3	300.0 ^d	0.08	80.0	<0.04	<40.0
Fecal coliform (MPN/100 ml)	<2	<8.7	<2	<8.7	<2	<8.7	2	8.7	2	8.7	<2	<8.7	<2	<8.7	<2	<8.7	<2	<8.7
Surfactants (NBAS)	<0.01	<2.0	<0.01	<2.0	0.02	4.0	<0.02	<4.0	0.08	16.0	0.02	4.0	0.01	<2.0	0.01	2.0	0.01	2.0
pH	8.5		7.6		8.2		8.4		7.9		8.4		8.4		8.1		7.8	
Rainfall (in.)	2.45		0.75		2.35		0.65		1.18		0.91		0.75		0.64		2.48	
Estimated rainfall runoff (gal)	3.8 x 10 ⁷		1.6 x 10 ⁷		3.8 x 10 ⁷		1.4 x 10 ⁷		2.5 x 10 ⁷		1.9 x 10 ⁷		1.7 x 10 ⁷		1.4 x 10 ⁷		5.6 x 10 ⁷	
Release volume (gal)	3.3 x 10 ⁶		5.0 x 10 ⁶		1.2 x 10 ⁶		2.5 x 10 ⁶		3.2 x 10 ⁶		2.6 x 10 ⁶		2.1 x 10 ⁶		3.1 x 10 ⁶		4.9 x 10 ⁶	

^aRainfall-related discharge^bNot applicable to discharges containing rainfall runoff during or immediately after periods of rainfall^cAttributed to naturally occurring chromium leaching from the soil^dAttributed to increased chlorine feed rate at treatment plant due to a lavatory malfunctionNote: Pond R-2A capacity - 2.5 x 10⁶ gal

0055U/sjh

III. ENVIRONMENTAL MONITORING PROGRAM

A. GENERAL DESCRIPTION

Soil and vegetation sample collection and analysis for radioactivity were initiated in 1952, in the Downey, California area, where the Energy Systems Group was initially located. Environmental sampling was subsequently extended to the then proposed SRE site in the Simi Hills in May of 1954. In addition, sampling was begun in the Burro Flats area, southwest of SRE, where other nuclear installations were planned and are currently in operation. The Downey area survey was terminated when nuclear activities were relocated to Canoga Park in 1955. The primary purpose of the environmental monitoring program is to survey environmental radioactivity adequately to ensure that ESG operations do not contribute significantly to environmental radioactivity. The locations of sampling stations are shown in Figures 5 through 7 and listed in Table 8.

B. SAMPLING AND SAMPLE PREPARATION

1. Soil

Soil is analyzed for radioactivity to monitor for any significant increase in radioactive deposition by fallout from airborne radioactivity. Since soil is naturally radioactive and has been contaminated by atmospheric testing of nuclear weapons, a general background level of radioactivity exists. The data are monitored for increases beyond the natural variability of this background.

Surface soil types available for sampling range from decomposed granite to clay and loam. Samples are taken from the upper 1 cm of undisturbed ground surface for gross radioactivity analysis and to a depth of 5 cm for plutonium analysis. The soil samples are packaged in plastic containers and returned to the laboratory for analysis.

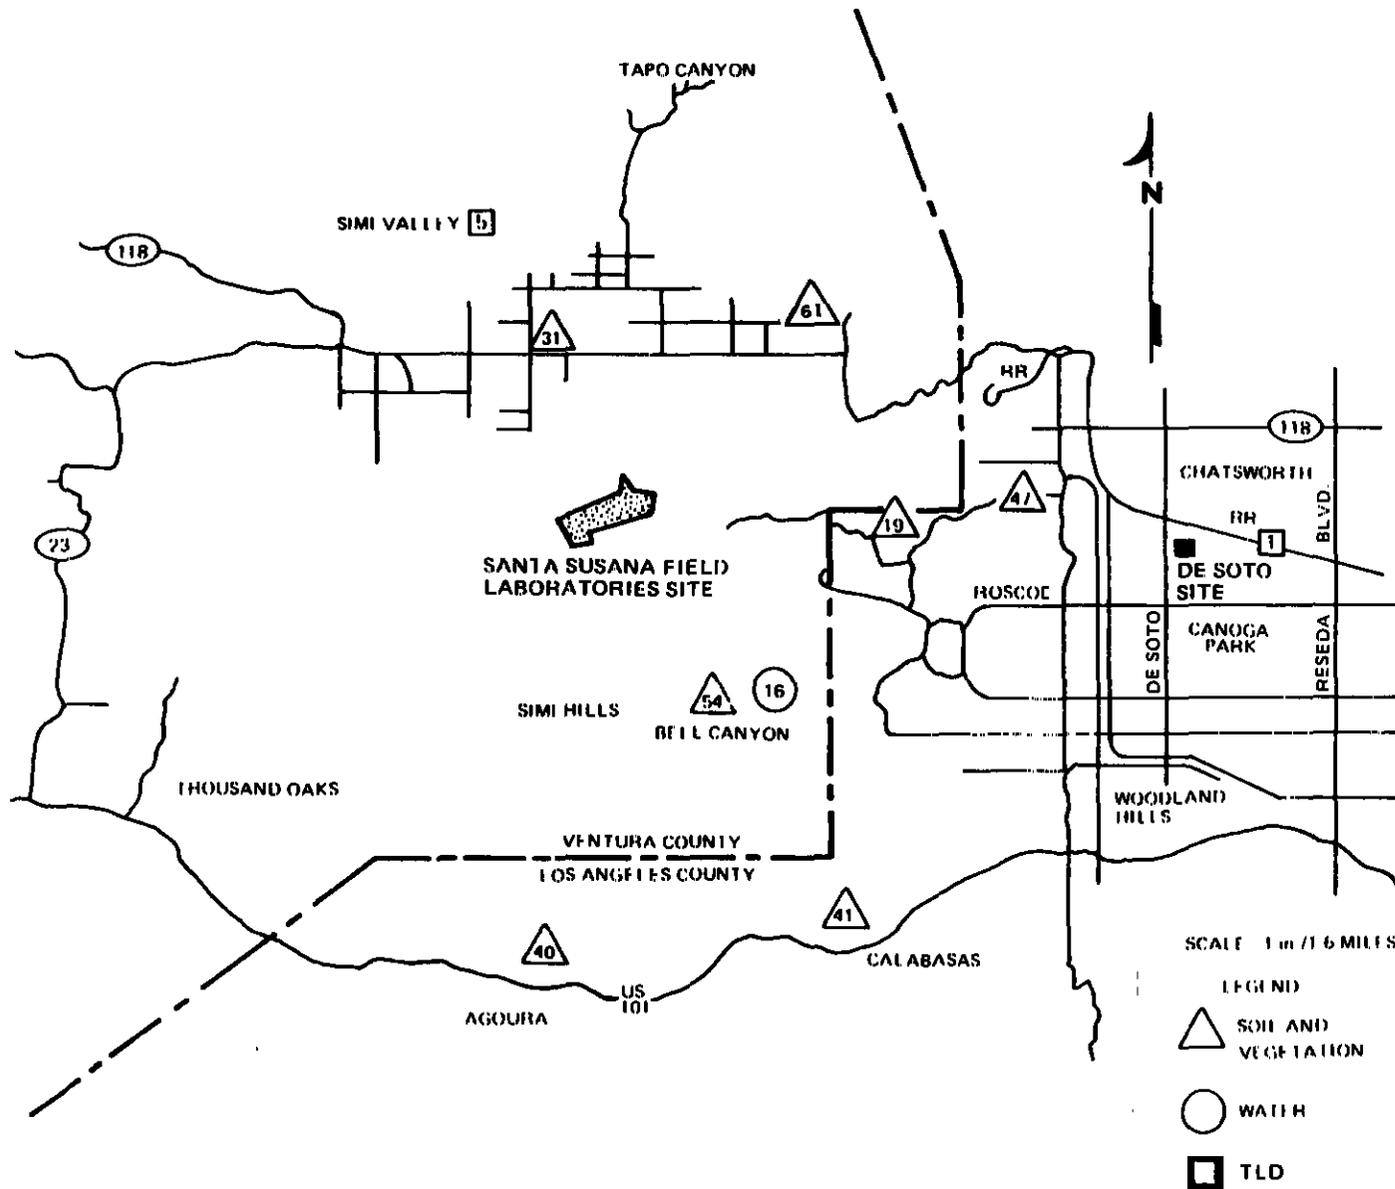


Figure 5. Map of Canoga Park, Simi Valley, Agoura, and Calabasas Sampling Stations

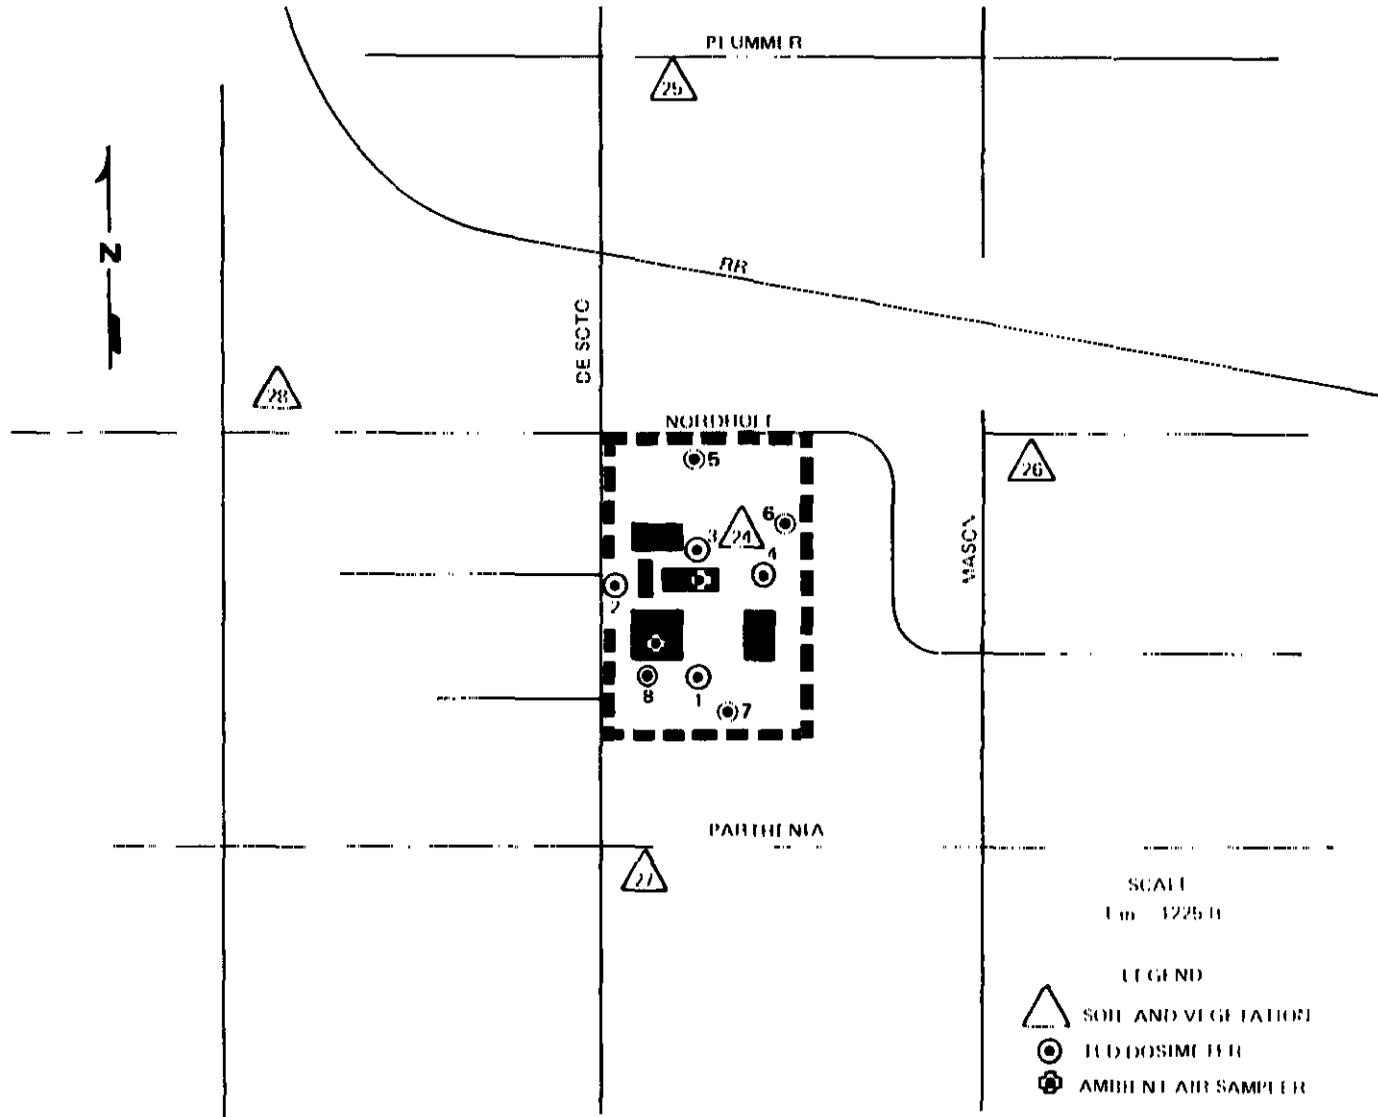


Figure 6. Map of De Soto Site and Vicinity Sampling Stations

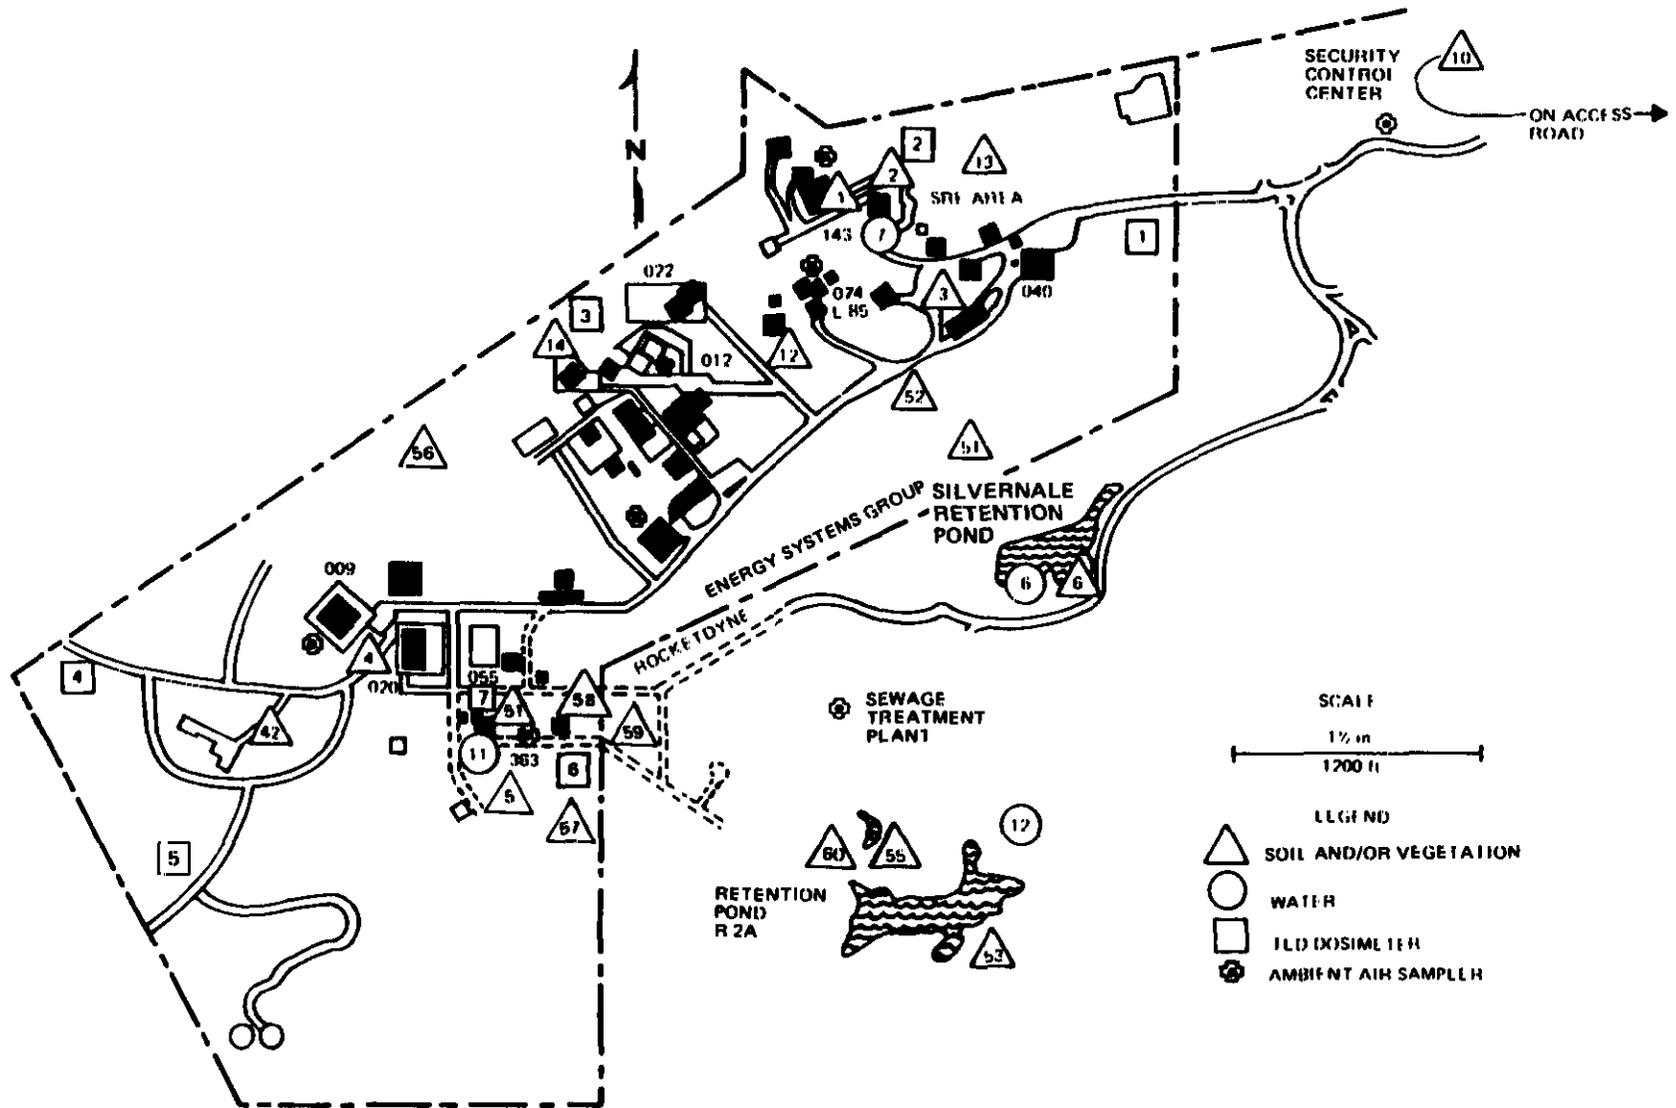


Figure 7. Map of Santa Susana Field Laboratories Site Sampling Stations

TABLE 8
SAMPLE STATION LOCATIONS
(Sheet 1 of 3)

Station	Location (frequency of sampling)
SV-1	SSFL Site, Bldg. 143 (M)
SV-2	SSFL Site, Below Bldg. 143 by Perimeter Drainage System Near Pond (M)
SV-3	SSFL Site, Bldg. 064 (M)
SV-4	SSFL Site, Bldg. 020 (M)
SV-5	SSFL Site, Bldg. 363 (M)
SV-6	Rocketdyne Site (Silvernale) Interim Retention Pond (Q)
SV-10	SSFL Site Access Road (Q)
SV-12	SSFL Site, Bldg. 093 (L-85 Reactor) (M)
SV-13	SSFL Site, at SRE Water Retention Pond (M)
SV-14	SSFL Site, Bldg. 028 (M)
SV-19	SSFL Site Entrance, Woolsey Canyon (Q)
SV-24	De Soto Site, Bldg. 004 (M)
SV-25	De Soto Avenue and Plummer Street (Q)
SV-26	Mason Avenue and Nordhoff Street (Q)
SV-27	De Soto Avenue and Parthenia Street (Q)
SV-28	Canoga Avenue and Nordhoff Street (Q)
SV-31	Simi Valley, Alamo Avenue and Sycamore Road (Q)
SV-40	Agoura - Kanan Road and Ventura Freeway (Q)
SV-41	Calabasas - Parkway Calabasas and Ventura Freeway (Q)
SV-42	SSFL Site, Bldg. 886 (M)
SV-47	Chatsworth Reservoir North Boundary (Q)
SV-51	SSFL Site, Bldg. 029 (M)
SV-52	SSFL Site, Burro Flats Drainage Control Channel, G Street and 17th Street (M)
SV-53	Rocketdyne Site Pond R-2A (Q)
SV-54	Bell Creek (M)

SV - Soil and Vegetation Sample Station
(M) - Monthly Sample
(Q) - Quarterly Sample

TABLE 8
SAMPLE STATION LOCATIONS
(Sheet 2 of 3)

Station	Location (frequency of sampling)
S-55	Rocketdyne Site Pond R-2A (Pond Bottom Mud) (M)
S-56	SSFL Site, F Street and 24th Street (S)
S-57	SSFL Site, J Street at Bldg. 055 (S)
S-58	SSFL Site, Bldg. 353 (S)
S-59	Rocketdyne Site Test Area CTL 4 (S)
S-60	Rocketdyne Site Pond R-2A (S)
S-61	Simi Valley, East End of Alamo Avenue (S)
W-6	Rocketdyne Site (Silvernale) Interim Retention Pond (Drains to Pond R-2A) (M)
W-7	SSFL Site Domestic Water, Bldg. 003 (M)
W-11	SSFL Site Domestic Water, Bldg. 363 (M)
W-12	Rocketdyne Site Pond R-2A (M)
W-16	Bell Creek (M)
A-1	De Soto Site, Bldg. 001 Roof (D) (relocated to Bldg. 002 Roof 08/20/83)
A-2	De Soto Site, Bldg. 004 Roof (D)
A-3	SSFL Site, Bldg. 009, West Side (D)
A-4	SSFL Site, Bldg. 011, West Side (D)
A-5	Rocketdyne Site, Bldg. 600, North Side (D)
A-6	Rocketdyne Site, Bldg. 207, North Side (D)
A-7	SSFL Site, Bldg. 074, South Side (D)
A-8	SSFL Site, Bldg. 143, West Side (D)
A-9	SSFL Site, Bldg. 363, North Side (D)

S - Soil Sample Station
W - Water Sample Station
A - Air Sample Station
(S) - Semiannual Sample
(M) - Monthly Sample
(D) - Daily Sample

TABLE 8
 SAMPLE STATION LOCATIONS
 (Sheet 3 of 3)

Station	Location (frequency of sampling)
TLD-1	De Soto Site, South of Bldg. 102 (Q)
TLD-2	De Soto Site, West Boundary (Q) (State of California TLD Location)
TLD-3	De Soto Site, Guard Post No. 1, Bldg. 201 (Q)
TLD-4	De Soto Site, East Fence (Q) (State of California TLD Location)
TLD-5	De Soto Site, North Boundary (Q)
TLD-6	De Soto Site, East Boundary (Q)
TLD-7	De Soto Site, South Boundary (Q)
TLD-8	De Soto Site (State of California TLD Location)
TLD-1	SSFL Site, Bldg. 114 (Q)
TLD-2	SSFL Site, SRE Retention Pond (Q)
TLD-3	SSFL Site, Electric Substation No. 719 (Q) (State of California TLD Location)
TLD-4	SSFL Site, West Boundary on H Street (Q)
TLD-5	SSFL Site, at Southwest Boundary (Q)
TLD-6	SSFL Site, Bldg. 854 (Q) (State of California TLD Location)
TLD-7	SSFL Site, Bldg. 363, North Side (Q) (State of California TLD Location)
TLD-1	Offsite, Northridge (Q) (State of California TLD Location)
TLD-2	Offsite, Simi Valley (Q)
TLD-3	Offsite, Northridge (Q)
TLD-4	Offsite, Simi Valley (Q)
TLD-5	Offsite, Simi Valley (Q) (State of California TLD Location)

TLD -- Thermoluminescent Dosimeter Location
 (Q) -- Quarterly Sample

Sample preparation for gross radioactivity determination consists of transferring the soils to Pyrex beakers and drying them in a muffle furnace at about 500°C for 8 h. After cooling, the soil is sieved to obtain uniform particle size. Two-gram aliquots of the sieved soil are weighed into copper planchets. The soil is wetted in the planchet with alcohol, evenly distributed to obtain uniform sample thickness, dried, and counted for alpha and beta radiation. Soil plutonium analysis is performed (according to the guidelines specified in U.S. NRC Regulatory Guide 4.5 titled "Measurements of Radionuclides in the Environment-Sampling and Analysis of Plutonium in Soil") by a certified independent testing laboratory.

2. Vegetation

The analysis of vegetation, performed as an adjunct to the soil analysis, is done to determine the uptake of radioactivity by plants. These plants do not contribute to the human food chain, and there is no significant agriculture or grazing in the immediate neighborhood of either site.

Vegetation samples obtained in the field are of the same perennial plant types, wherever possible; these are usually sunflower or wild tobacco. Vegetation leaves are stripped from plants and placed in ice cream cartons for transfer to the laboratory for analysis. Ordinarily, plant root systems are not analyzed.

Since the analysis is done to determine uptake only, and not fallout deposition, vegetation is first washed with tap water to remove foreign matter and then thoroughly rinsed with distilled water. Washed vegetation is vacuum dried in tared beakers at 100°C for 24 h for dry weight determination, then ashed in a muffle furnace at about 500°C for 8 h, producing a completely burned ash. One-gram aliquots of pulverized ash from each beaker are weighed into copper planchets. The vegetation ash is wetted in the planchet with alcohol, evenly distributed to obtain uniform sample thickness, dried, and counted for alpha and beta radiation. The dry/ash weight ratio is used for determining the equivalent dry weight gross radioactivity concentration value. The moisture content of the vegetation is about 80% of total plant weight.

3. Water

Surface and domestic supply water samples are obtained monthly at the De Soto and SSFL sites and from Bell Creek. The water is drawn into 1-liter polyethylene bottles and transferred to the laboratory.

Five-hundred-milliliter volumes of water are evaporated to dryness in crystallizing dishes at about 90°C. The residual salts are redissolved into distilled water, transferred to planchets, dried under heat lamps, and counted for alpha and beta radiation.

4. Ambient Air

Air sampling is performed continuously at the De Soto and SSFL sites with automatic air samplers, operating on 24-h sampling cycles. Airborne particulate radioactivity is collected on Type A/E glass fiber filter media, which are automatically changed daily at the end of each sampling period. The samples are counted for alpha and beta radiation following a minimum 120-h decay period. The volume of a typical daily ambient air sample is about 25 m³.

Figure 8 is a graph of the weekly long-lived alpha and beta ambient air radioactivity concentrations for the De Soto and SSFL sites during 1983. The daily data were mathematically smoothed by a program that calculates a moving weekly average of daily data for the year. The average alpha and beta radioactivity concentrations for each month are indicated by horizontal bars. The graph shows small decreasing trends in airborne radioactivity during the first and fourth quarters, with a small increase in the summer; however, overall levels were generally constant for the year. Several transient peak concentration levels were observed within the general trend. This activity is attributed to naturally occurring airborne radioactive materials and to residual aged fallout from past foreign atmospheric tests of nuclear devices. Nuclides identified in air samples collected during 1983 include Be⁷, Cs¹³⁷, and K⁴⁰, plus several of the naturally occurring radionuclides from the uranium and thorium series. While the data for airborne alpha activity are all below the minimum detection level for a single sample, averaging over 7 consecutive days, and over calendar months reveals the long-term behavior of this activity.

ESG-84-9
40

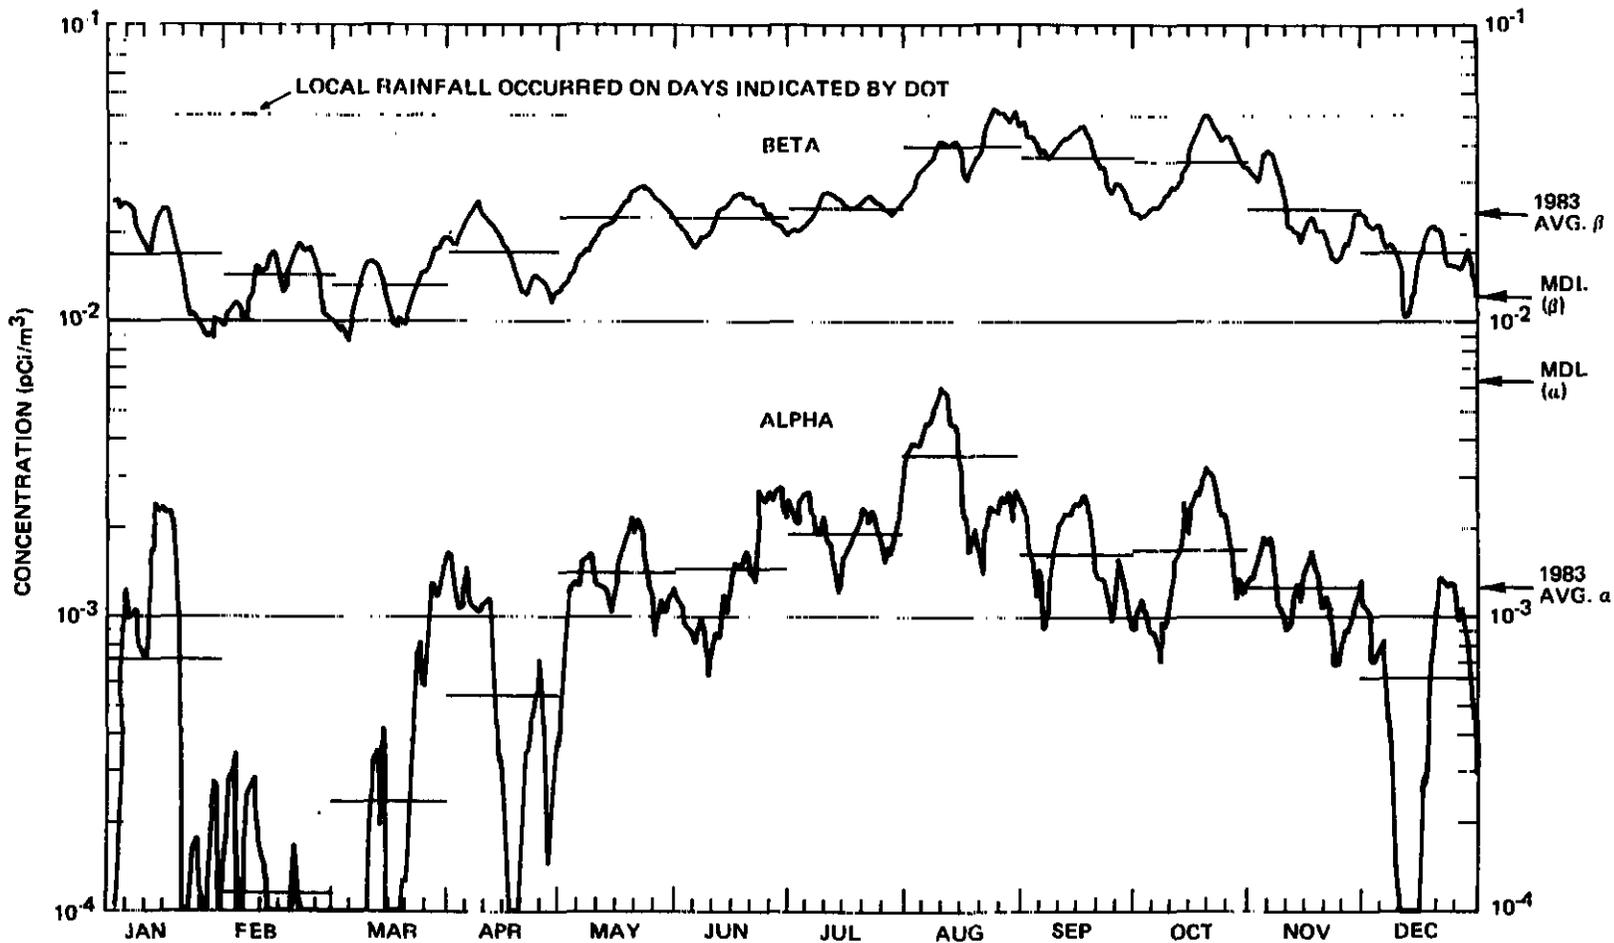


Figure 8. Weekly, Monthly, and Annual Averaged Long-Lived Airborne Radioactivity at the De Soto and Santa Susana Field Laboratories Sites - 1983

C. COUNTING AND CALIBRATION

Environmental soil, vegetation, water, and ambient air samples are counted for alpha and beta radiation with a low-background gas flow proportional counting system. The system is capable of simultaneously counting both alpha and net beta radiation. The sample-detector configuration provides a nearly 2π geometry. The thin-window detector is continually purged with methane counting gas. A preset time mode of operation is used for all samples. The minimum detection levels shown in Table 9 are those for a single sample determined by using typical values for counting time, system efficiencies for detecting alpha and beta radiation, background count rates (approximately 0.05 cpm α and 1.0 cpm β), and sample size. For the table, the minimum statistically significant amount of radioactivity, irrespective of sample configuration, is taken as that amount equal in count rate to three times the standard deviation of the system background count rate.

TABLE 9
MINIMUM RADIOACTIVITY DETECTION LEVELS (MDLs)

Sample	Activity	Minimum Detection Level
Soil	α	$(5.8 \pm 3.4) 10^{-8} \mu\text{Ci/g}$
	β	$(2.3 \pm 1.2) 10^{-7} \mu\text{Ci/g}$
Vegetation	α	$(1.2 \pm 0.7) 10^{-7} \mu\text{Ci/g ash}$
	β	$(3.6 \pm 1.8) 10^{-7} \mu\text{Ci/g ash}$
Water	α	$(2.3 \pm 1.4) 10^{-10} \mu\text{Ci/ml}$
	β	$(6.4 \pm 3.2) 10^{-10} \mu\text{Ci/ml}$
Air	α	$(6.4 \pm 3.8) 10^{-15} \mu\text{Ci/ml}$
	β	$(1.3 \pm 0.6) 10^{-14} \mu\text{Ci/ml}$

Counting system efficiencies are determined routinely with Ra-D+E+F (with alpha absorber), Cl^{36} , Th^{230} , U^{235} , and Pu^{239} standard sources and with K^{40} , in the form of standard reagent-grade KCl, which is used to simulate soil and

vegetation samples. Self-absorption standards are made by dividing sieved KCl into samples, increasing in mass by 200-mg increments, from 100 to 3000 mg. The samples are placed in copper planchets of the type used for environmental samples and are counted. The ratio of sample activity to the observed net count rate for each sample is plotted as a function of sample weight. The correction factor (ratio) corresponding to sample weight is obtained from the graph. The product of the correction factor and the net sample count rate yields the sample activity (dpm). This method has been proven usable by applying it to various-sized aliquots of uniformly mixed environmental samples and observing that the resultant specific activities fell within the expected statistical counting error.

Since the observed radioactivity in environmental samples is primarily the result of natural sources and weapons-testing, and is at such low concentrations, no effort is normally made to identify individual radionuclides. The detection of significant levels of radioactivity would lead to an investigation of the radioactive material involved, the sources, and the possible causes.

D. NONRADIOACTIVE MATERIALS

The Rocketdyne Division of Rockwell International Corporation has filed a Report of Waste Discharge with the California Regional Water Quality Control Board and has been granted a National Pollutant Discharge Elimination System permit to discharge wastewater, pursuant to Section 402 of the Federal Water Pollution Control Act. The permit, NPDES No. CA0001309, became effective on 27 September 1976 and supersedes all previously held permits for wastewater discharge from the Rocketdyne Division, SSFL. This permit covers discharge of overflow and storm runoff from water reclamation retention ponds into Bell Creek. Discharge generally occurs only during and immediately after periods of heavy rainfall or during extended periods of rocket engine testing.

Only one of the retention ponds receives influent from the ESG-SSFL site. It is identified as retention pond R-2A, Water Sample Station W-12 in Table 8.

The influent includes sewage treatment plant outfall and surface runoff water. Grab-type water samples, taken at the retention pond prior to a discharge, are analyzed for nonradioactive chemical constituents and for radioactivity by a California State certified analytical testing laboratory. The specific constituents analyzed for, and their respective limitations in discharged wastewater, are presented in Appendix C. Wastewater originating from facilities located throughout the SSFL site is collected at the retention pond. The point of origin of nonradioactive constituents normally found in wastewater is impossible to determine; however, in the event of excessive amounts of any of these materials in wastewater, the origin could be determined from the knowledge of facility operations involving their use. Nineteen offsite discharges of wastewater from Pond R-2A occurred during 1983.

In addition to the wastewater discharge limitations, atmospheric pollutant discharge limitations were imposed by Ventura County Air Pollution Control District Permit 0271 on one of two oil-fired sodium heaters operated by ETEC. The limit is that no more than 100 tons of any pollutant may be discharged per year, with no other restrictions imposed. During 1985, the APCD permit will be renewed with anticipated specific pollutant monitoring requirements and limitations. An investigation to determine emission of particulates, hydrocarbons, carbon monoxide, carbon dioxide, nitrogen oxides, and oxygen was conducted in 1983 in anticipation of future permit requirements. The testing results ranged from an annualized (continuous operation) mass flow of 20 tons for particulates to about 104 tons for dry nitrogen oxides.

IV. EFFLUENT MONITORING PROGRAM

Effluents that may contain radioactive material are generated at ESG facilities as the result of operations performed under contract to DOE, under NRC Special Nuclear Materials License SNM-21, under State of California Radioactive Material License 0015-70, and under contract to the Department of Energy. The specific facilities are identified as Buildings 001 and 004 at the De Soto site, and Buildings 020, 021, 022, and 055 at the Santa Susana site, SSFL.

A. TREATMENT AND HANDLING

Waste streams released to unrestricted areas are limited, in all cases, to atmospheric emissions. No contaminated liquids are discharged to unrestricted areas.

The level of radioactivity contained in all atmospheric emissions is reduced to the lowest values by passing the emissions through certified, high-efficiency particulate air (HEPA) filters. These emissions are sampled for particulate radioactive materials by means of continuously operating stack exhaust samplers at the points of release. In addition, stack monitors installed at Buildings 020, 022, and 055 provide automatic alarm capability in the event of the release of gaseous or particulate activity from Building 020 and particulate activity from Buildings 022 and 055. The HEPA filters used for filtering atmospheric emissions are at least 99.97% efficient for particles of 0.3- μm diameter. Particle filtration efficiency increases for particles above and below this size.

The average concentration and total radioactivity in atmospheric emissions to unrestricted areas are shown in Table 10. The effectiveness of the air cleaning systems is evident from the fact that, in most cases, the atmospheric emissions are less radioactive than is ambient air. The total shows that no significant quantities of radioactivity were released in 1983.

TABLE 10
ATMOSPHERIC EMISSIONS TO UNRESTRICTED AREAS - 1983

Building	Approximate Emissions Volume (ft ³)	Activity Monitored	Approximate Minimum Detection Level (μCi/ml)	Annual Average Concentration (μCi/ml)	Sampling Period Maximum Observed Concentration (μCi/ml)	Total Radioactivity Released (Ci)	Percent of Guide ^a	Percent of Samples With Activity < MDL
001 ^c De Soto	9.0 x 10 ⁹	α	1.6 x 10 ⁻¹⁶	2.5 x 10 ⁻¹³	7.9 x 10 ⁻¹³	5.2 x 10 ⁻⁵	8.33	0
		β	5.4 x 10 ⁻¹⁶	8.8 x 10 ⁻¹⁴	2.8 x 10 ⁻¹³	1.9 x 10 ⁻⁵	0.029	0
004 De Soto	1.2 x 10 ¹⁰	α	2.1 x 10 ⁻¹⁶	2.6 x 10 ⁻¹⁵	3.1 x 10 ⁻¹⁴	1.1 x 10 ⁻⁶	0.087	33
		β	7.2 x 10 ⁻¹⁶	2.8 x 10 ⁻¹⁵	1.7 x 10 ⁻¹⁴	1.1 x 10 ⁻⁶	0.0009	25
020 SSFL	1.2 x 10 ¹⁰	α	0.9 x 10 ⁻¹⁶	7.8 x 10 ⁻¹⁷	4.0 x 10 ⁻¹⁶	2.4 x 10 ⁻⁸	0.13	63
		β	3.0 x 10 ⁻¹⁶	4.1 x 10 ⁻¹⁵	1.6 x 10 ⁻¹⁴	1.3 x 10 ⁻⁶	0.014	0
021-022 SSFL	1.2 x 10 ¹⁰	α	0.9 x 10 ⁻¹⁶	1.4 x 10 ⁻¹⁶	1.1 x 10 ⁻¹⁵	4.7 x 10 ⁻⁸	0.23	50
		β	3.0 x 10 ⁻¹⁶	3.4 x 10 ⁻¹⁵	1.6 x 10 ⁻¹⁴	1.1 x 10 ⁻⁶	0.011	0
055 SSFL	9.1 x 10 ⁹	α	2.9 x 10 ⁻¹⁶	3.8 x 10 ⁻¹⁶	3.1 x 10 ⁻¹⁵	8.0 x 10 ⁻⁸	0.63	63
		β	9.6 x 10 ⁻¹⁶	4.7 x 10 ⁻¹⁵	1.3 x 10 ⁻¹⁴	1.1 x 10 ⁻⁶	0.16	0
Total	5.4 x 10 ¹⁰				Total	7.7 x 10 ⁻⁵		
Annual average ambient air radioactivity concentration ^b (μCi/ml) - 1983		α		1.8 x 10 ^{-15^b}	Ambient equivalent ^d	1.83 x 10 ⁻³		
		β		3.2 x 10 ^{-14^b}				

^a Assuming all radioactivity detected is from ESG operations.

Guide: De Soto site: 3 x 10⁻¹² μCi/ml alpha, 3 x 10⁻¹¹ μCi/ml beta; 10 CFR 20 Appendix B.
SSFL site: 6 x 10⁻¹⁴ μCi/ml alpha, 3 x 10⁻¹¹ μCi/ml beta, 3 x 10⁻¹² Ci/ml beta (055 only);
10 CFR 20 Appendix B, CAC-17, and DOE Order 5480.1 Chapter XI.

^b Averaged result for 7-day (202 m³) De Soto continuous air sampler.

^c System permanently removed from service on July 29, 1983, at 0930.

^d Natural radioactivity contained in volume of air discharged through ESG exhaust systems after filtration.

Note: All release points are at the stack exit.

Liquid wastes released to sanitary sewage systems, a controlled area as provided for by CAC 17 and 10 CFR 20, are generated at the De Soto site only. Liquid wastes are discharged from Building 001 following analysis for radioactivity concentration. There is no continuous flow. Building 004 chemical wastes are released to an automatic discharge cycle retention tank system, which periodically samples and composites aliquots of the tank contents prior to each discharge of a fixed volume of wastewater to the facility sanitary sewerage. No radioactive liquid effluents are released from Santa Susana Buildings 020, 021, 022, or 055. Liquid radioactive waste generated at SSFL is evaporated or solidified for land burial. The average concentration and total radioactivity in effluents discharged are shown in Table 11.

B. ENERGY SYSTEMS GROUP FACILITY DESCRIPTIONS

1. De Soto Site

a. Building 001 — NRC and California State Licensed Activities

Operations at Building 001 that may generate radioactive effluents consist of the decommissioning and dismantling of the facility formerly associated with the manufacture of enriched uranium fuel elements. Only atmospheric emissions are released from the building to uncontrolled areas. Following analysis for radioactivity concentration, liquid wastes are released to the sanitary sewage system, which is considered a controlled area, as provided by CAC 17 and 10 CFR 20. Nuclear fuel material handled in unencapsulated form in this facility contained the uranium isotopes U^{234} , U^{235} , U^{236} , and U^{238} .

b. Building 004 — NRC and California State Licensed Activities

Operations at Building 004 that may generate radioactive effluents consist of research studies in physical chemistry, and the chemical analysis of small quantities of fuel and byproduct materials. Only atmospheric emissions are

TABLE 11
LIQUID EFFLUENT DISCHARGED TO SANITARY SEWER 1983

Building	Point of Release	Approximate Volume (gal)	Activity Monitored	Approximate MDL ($\mu\text{Ci}/\text{ml}$)	Annual Average Concentration ($\mu\text{Ci}/\text{ml}$)	Diluted Concentration ($\mu\text{Ci}/\text{ml}$)	Sample Maximum Observed Concentration ($\mu\text{Ci}/\text{ml}$)	Total Radioactivity Released (Ci)	Percent of Guide ^b
001	Retention tank	29,750		1.0×10^{-9}	3.8×10^{-7}	0.9×10^{-9}	1.3×10^{-6}	4.5×10^{-5}	0.042
				3.7×10^{-9}	8.5×10^{-7}	2.1×10^{-9}	7.6×10^{-6}	1.0×10^{-4}	0.085
004	Flow sampler	366,700		1.0×10^{-9}	$4.3 \times 10^{-9\text{c}}$	0.1×10^{-9}	1.6×10^{-8}	6.2×10^{-6}	<0.001
				3.7×10^{-9}	$1.3 \times 10^{-7\text{c}}$	3.9×10^{-9}	7.8×10^{-7}	1.8×10^{-4}	0.013
Supply water		396,450		2.3×10^{-10} 6.4×10^{-10}	0.34×10^{-9} 3.53×10^{-9}		0.88×10^{-9} 5.1×10^{-9}	5.1×10^{-7} 5.3×10^{-6}	
Effluent water		12,100,000			d			6.0×10^{-5} 2.6×10^{-4}	
020 ^a	-	0	-	-	-	-	-	-	-
021-022 ^a	-	0	-	-	-	-	-	-	-
055 ^a	-	0	-	-	-	-	-	-	-

^aAll liquid radioactive wastes are solidified and land buried as dry waste

^bGuide: 9×10^{-4} $\mu\text{Ci}/\text{ml}$ alpha, 1×10^{-3} $\mu\text{Ci}/\text{ml}$ beta; 10 CFR 20 Appendix B, CAC-17

^cPercent of samples < MDL: 15.7% alpha activity, 0% beta activity

^dAssumed equal to supply water for this comparison

released from the building to uncontrolled areas. Liquid laboratory wastes are released to an interim retention tank installation. Aliquots from the tank are composited and analyzed for radioactivity. Nuclear fuel material handled in unencapsulated form in this facility contains the uranium isotopes U^{234} , U^{235} , U^{236} , and U^{238} . Major quantities of other radionuclides in encapsulated form include Co^{60} and Pm^{147} . No significant quantities of these radionuclides were released.

2. Santa Susana Field Laboratories Site

a. Building 020 – NRC and California State Licensed Activities

Operations at Building 020 that may generate radioactive effluents consist of hot cell examination and decladding of irradiated nuclear fuels and examination of reactor components. Only atmospheric emissions are released from the building to uncontrolled areas. The discharge may contain particulate material, as well as radioactive gases, depending on the operations being performed and the history of the irradiated fuel or other material. No radioactive liquid waste is released from the facility. Radioactive material handled in unencapsulated form in this facility includes the following radionuclides: Th, U, Pu, as constituents in the various fuel materials; and Cs^{137} , Sr^{90} , Kr^{85} , and Pm^{147} as mixed fission products.

b. Buildings 021 and 022 – DOE Contract Activities

Operations at Buildings 021 and 022 that may generate radioactive effluents consist of the processing, packaging, and temporary storage of liquid and dry radioactive waste material for disposal. Only atmospheric emissions are released from the building to uncontrolled areas. No radioactive liquid waste is released from the facility. Nuclear fuel material handled in encapsulated or unencapsulated form contains the uranium isotopes U and Pu, plus Cs^{137} , Sr^{90} , and Pm^{147} as mixed fission products.

c. Building 055 -- NRC and California State Licensed Activities

Operations at Building 055 that may generate radioactive effluents consist of converting UC waste to the oxide state and decommissioning and decontamination of facility equipment. Only atmospheric emissions are released from the facility to uncontrolled areas. No radioactive liquid waste is released from the facility.

The various fuel materials that have been used at the facility (depleted and enriched uranium and plutonium) contained the following radionuclides: U plus Pu^{238} , Pu^{239} , Pu^{240} , Pu^{241} , and Am^{241} .

C. ESTIMATION OF GENERAL POPULATION DOSE ATTRIBUTABLE TO ESG OPERATIONS -- 1983

The Los Angeles basin is a semiarid region whose climate is controlled primarily by the semipermanent Pacific high-pressure cell that extends from Hawaii to the southern California coast. The seasonal changes in the position of this cell greatly influence the weather conditions in this area. During the summer months, the high pressure is displaced to the north. This results in mostly clear skies with little precipitation. During the winter, the cell moves sufficiently southward to allow some Pacific lows with their associated frontal systems to move into the area. This produces light to moderate precipitation with northerly and northwesterly winds.

The release of airborne material at the De Soto site for summer season weather conditions would generally be under a subsidence inversion into an atmosphere that is typical of slight neutral to lapse conditions. Nocturnal cooling inversions, although present, are relatively shallow in extent. During the summer, a subsidence inversion is present almost every day. The base and top of this inversion usually lie below the elevation of the SSFL site. Thus, any atmospheric release from the SSFL site under this condition would result in Pasquill Type D lofting diffusion conditions above the inversion and considerable atmospheric dispersion, prior to any diffusion through the inversion into the Simi or San Fernando Valleys. In the winter season, the Pacific high-pressure

cell shifts to the south and the subsidence inversion is usually absent. The surface air flow is then dominated by frontal activity moving through the area or to the east, resulting in high-pressure systems in the great basin region. Frontal passages through the area during winter are generally accompanied by precipitation. Diffusion characteristics are highly variable depending on the location of the front. Generally, a light to moderate southwesterly wind precedes these frontal passages, introducing a strong onshore flow of marine air and producing lapse rates that are slightly unstable. Wind speeds increase as the frontal systems approach, enhancing diffusion. The diffusion characteristics of the frontal passage are lapse conditions with light to moderate northerly winds. Locally, average wind speeds for the various stability categories range from 0 to about 4.4 m/s with the greatest frequency occurring for winds from the north to northwest sectors. Local population distribution estimates projected for 1981, based on the 1980 federal census, for areas surrounding the De Soto and SSFL sites and out to 80 km for 16 sectors are shown in Tables 12 and 13.

The downwind concentration of radioactive material emissions to the atmosphere during 1983 from each of the four major ESG nuclear facilities has been calculated with the AIRDOS-EPA computer code using site-specific input data.

To determine the maximum radioactivity concentrations at the nearest site boundary and at the nearest residence, a mean wind speed of 2.2 m/s for each stability class was used to evaluate the plume centerline (maximum) concentrations toward the sector in which those locations lie. The 80-km concentration is not direction specific but is given for comparison with the nearby concentration values. The concentration estimates are shown in Table 14, and both indirect and direct radiation dose estimates are shown in Table 15.

The general population man-rem dose estimates are calculated from the demographic distribution and the sector total inhalation intake (man-pCi/year) generated by AIRDOS-EPA, which uses release rate, wind speed, wind direction and frequency, inversion, lapse, and effective stack height parameters as input data. Population dose estimates are presented in Tables 16 and 17 for the De Soto and SSFL sites. The exposure mode is by inhalation with lung the critical

TABLE 12
DE SOTO SITE DEMOGRAPHY
(34°13'54"N, 118°35'12"W)

22.5° Sector	Centered Azimuth Direction Toward (deg)	0-1.6 km	1.6-3.2 km	3.2-4.8 km	4.8-6.4 km	6.4-8 km	8-16 km	16-32 km	32-48 km	48-64 km	64-80 km	Total
N	0	0	527	3,437	8	0	2,483	31,112	5,718	738	2,444	46,467
NNE	22-1/2	1,407	4,360	4,542	4,550	10,388	5,022	22,207	6,734	25,388	42,248	126,846
NE	45	126	3,616	4,391	3,181	10,563	64,364	18,639	5,383	21,750	6,932	138,945
ENE	67-1/2	0	0	7,263	4,551	7,499	107,317	87,278	3,078	271	552	217,809
E	90	2,701	4,204	6,088	8,807	13,290	111,190	277,042	470,238	492,682	368,758	1,755,000
ESE	112-1/2	1,430	2,455	7,169	9,837	11,371	78,493	478,488	1,151,795	811,774	852,309	3,405,121
SE	135	1,324	4,045	8,717	10,886	16,600	35,573	410,956	795,894	773,769	229,030	2,286,794
SSE	157-1/2	929	7,681	9,530	2,543	8,131	6,519	87,880	0	55,599	0	178,812
S	180	0	5,744	3,743	2,309	5,549	17,658	7,554	0	0	0	42,557
SSW	202-1/2	4,384	3,778	7,330	9,866	9,330	15,514	4,905	0	0	0	55,107
SW	225	3,697	2,633	6,863	3,614	9,768	3,139	27,213	969	0	0	57,896
WSW	247-1/2	0	5,295	1,189	4,232	4	0	82,022	39,794	136,563	0	269,099
W	270	0	0	897	51	0	26,335	38,145	49,946	84,637	34,472	234,483
WNW	292-1/2	0	2,106	0	0	564	26,119	809	12,534	1,887	1,556	45,575
NW	315	0	7,561	0	0	0	97	1,565	0	241	1,987	11,451
NNW	337-1/2	0	2,861	2,004	392	0	414	16,387	4,449	280	288	27,075
Total		15,998	56,866	73,163	64,827	103,057	500,237	1,592,202	2,546,532	2,405,579	1,540,576	8,899,037

ESG-84-9
52

TABLE 13

SANTA SUSANA FIELD LABORATORIES SITE DEMOGRAPHY
(34°13'50"N, 118°42'45"W)

22.5° Sector	Centered Azimuth Direction Toward (deg)	0-1.6 km	1.6-3.2 km	3.2-4.8 km	4.8-6.4 km	6.4-8 km	8-16 km	16-32 km	32-48 km	48-64 km	64-80 km	Total
N	0	0	0	2,436	3,597	7,682	97	16,387	4,449	730	89	35,467
NNE	22-1/2	0	0	0	8,350	2,468	41	33,977	8,274	3,815	24,562	81,487
NE	45	0	1,209	0	564	0	392	26,411	9,844	4,270	63,563	106,253
ENE	67-1/2	0	0	0	51	883	45,597	264,064	58,027	10	1,219	369,851
E	90	0	0	0	2,107	5,661	111,226	405,120	522,360	692,884	581,012	2,320,370
ESF	112-1/2	0	0	0	548	8,346	53,282	138,131	1,189,218	1,180,366	1,015,060	3,584,951
SF	135	0	0	0	0	0	18,022	80,026	177,617	515,221	200,041	990,927
SSF	157-1/2	0	0	0	113	3,025	0	5,183	0	0	0	8,321
S	180	0	0	0	0	0	8,876	4,134	0	0	0	13,010
SSW	202-1/2	0	0	0	4,396	0	10,474	6,638	0	0	0	21,508
SW	225	0	0	0	0	0	15,395	1,125	0	0	0	16,520
WSW	247-1/2	0	0	0	0	0	38,005	58,298	135,222	3,195	0	234,720
W	270	0	0	0	0	0	3,982	28,824	77,255	42,697	13,212	165,970
WNW	292-1/2	0	0	2,914	3,145	14,747	3,237	7,964	12,288	18,433	0	62,728
NW	315	0	0	4,093	13,753	4,001	0	7,861	0	241	618	30,567
NNW	337-1/2	0	0	0	6,144	3,257	607	1,565	0	0	2,186	13,759
Total		0	1,209	9,443	42,768	50,070	309,233	1,085,708	2,194,554	2,461,862	1,901,502	8,056,409

TABLE 14
 MAXIMUM DOWNWIND PLUME CENTERLINE CONCENTRATIONS
 OF ATMOSPHERIC EMISSIONS — 1983

Facility	Release Rate (Ci/year)	Distance (m) to		Downwind Concentration ($\mu\text{Ci}/\text{cm}^3$) ^a		
		Boundary	Residence	Boundary	Residence	80 km
B/001	7.1×10^{-5}	110 W	171 SW	5.8×10^{-16}	6.3×10^{-16}	2.0×10^{-18}
B/020	1.3×10^{-6}	305 NW	1900 SE	1.6×10^{-18}	8.9×10^{-19}	3.1×10^{-20}
B/022	1.2×10^{-6}	350 NW	2300 SE	5.2×10^{-19}	4.4×10^{-19}	2.5×10^{-20}
B/055	1.1×10^{-6}	400 NW	1830 SE	3.1×10^{-18}	1.0×10^{-18}	2.7×10^{-20}

^aAssume $\bar{u} = 2.2$ m/s average wind speed, constant direction, full year.

organ for U and Pu, and bone for Sr⁹⁰. The doses reported for SSFL site emissions are summed for all release points and nuclides.

The estimated offsite doses are extremely low compared with the maximum permissible exposures recommended for the general population. These maximum permissible values are 3 rem/year for bone and 1.5 rem/year for the lung for an individual. The general population values are one-third of the individual exposures. The maximum estimated direct and indirect exposures for 1983 at the De Soto and Santa Susana site boundaries to an individual and at the nearest residence are shown in Table 15. Boundary exposures assume 100% occupancy, whereas the actual presence of persons at the boundary is rare or nonexistent. Review of the data indicates that these derived values are not statistically different from zero, as shown by the uncertainties being greater than the reported value, but result from conservatism in the analysis. Those values are less than 3% of the permissible level of radiation in unrestricted areas of 500 mrem per year to any individual as specified in 10 CFR 20.105, CAC-17 Section 30268, and DOE Order 5480.1, Chapter XI, Part 4.b. Estimated indirect radiation doses due to atmospheric emission of radioactive materials from ESG facilities are a small fraction of the recommended limits and are far below doses due to internal exposure to natural radioactivity in air, which is approximately 50 to 100 mrem/year.

TABLE 15
MAXIMUM INDIVIDUAL EXPOSURE — 1983

Site	Indirect (Internal) Exposure - mrem		Direct (External) Exposure - mrem ^a	
	Boundary	Residence	Boundary	Residence
De Soto	$(2.2 \pm 3.6) \times 10^{-1}$	$(2.4 \pm 3.7) \times 10^{-1}$	3 = 6	1 = 3
SSFL	$(1.4 \pm 2.2) \times 10^{-3}$	$(4.6 \pm 6.9) \times 10^{-4}$	2 = 9 ^b	0.09 = 0.22
Natural	80-130		100-120	

^aExposure above background, based on greatest exposure measured by single L compared to average adjusted offsite measurements.

^bSource of radiation assumed to be operations at RIHL, Bldg. 020.

NOTE: Mean adjusted value for five offsite dosimeters was 116 mrem with a maximum observed value of 124 mrem for the year.

TABLE 16
POPULATION DOSE ESTIMATES FOR ATMOSPHERIC EMISSIONS
FROM THE DE SOTO FACILITY - 1983

22.5° Sector	Dose to Receptor Population Segment (man-rem)						
	0-8 km	8-16 km	16-32 km	32-48 km	48-64 km	64-80 km	Total
N	1.9×10^{-2}	2.4×10^{-3}	1.4×10^{-2}	1.6×10^{-3}	1.5×10^{-4}	4.0×10^{-4}	3.8×10^{-2}
NNW	2.0×10^{-2}	2.4×10^{-4}	4.4×10^{-3}	7.7×10^{-4}	3.5×10^{-5}	2.9×10^{-5}	2.5×10^{-2}
NW	3.5×10^{-2}	5.7×10^{-5}	4.2×10^{-4}	0	3.0×10^{-5}	2.0×10^{-4}	3.6×10^{-2}
WNW	2.1×10^{-2}	3.1×10^{-2}	4.4×10^{-4}	4.3×10^{-3}	4.8×10^{-4}	3.1×10^{-4}	5.8×10^{-2}
W	3.1×10^{-3}	1.9×10^{-2}	1.3×10^{-2}	1.1×10^{-2}	1.3×10^{-2}	4.2×10^{-3}	6.3×10^{-2}
WSW	2.3×10^{-2}	0	1.5×10^{-2}	4.5×10^{-3}	1.1×10^{-2}	0	5.4×10^{-2}
SW	4.7×10^{-2}	9.4×10^{-4}	3.8×10^{-3}	8.6×10^{-5}	0	0	5.2×10^{-2}
SSW	6.5×10^{-2}	5.0×10^{-3}	7.3×10^{-4}	0	0	0	7.1×10^{-2}
S	5.5×10^{-2}	1.2×10^{-2}	2.4×10^{-3}	0	0	0	6.9×10^{-2}
SSE	1.2×10^{-1}	5.1×10^{-3}	3.2×10^{-2}	0	9.4×10^{-3}	0	1.7×10^{-1}
SE	1.3×10^{-1}	2.7×10^{-2}	1.4×10^{-1}	1.8×10^{-1}	1.3×10^{-1}	2.9×10^{-4}	6.1×10^{-1}
ESE	8.1×10^{-2}	4.7×10^{-2}	1.3×10^{-1}	2.0×10^{-1}	1.0×10^{-1}	8.6×10^{-2}	6.4×10^{-1}
E	7.1×10^{-2}	4.7×10^{-2}	5.4×10^{-2}	5.9×10^{-2}	4.5×10^{-2}	2.6×10^{-2}	3.0×10^{-1}
ENE	1.8×10^{-2}	3.1×10^{-2}	1.2×10^{-2}	2.7×10^{-4}	1.7×10^{-5}	2.7×10^{-5}	6.1×10^{-2}
NE	3.3×10^{-2}	2.6×10^{-2}	3.4×10^{-3}	6.4×10^{-4}	1.9×10^{-3}	4.7×10^{-4}	6.5×10^{-2}
NNE	7.1×10^{-2}	2.9×10^{-3}	5.9×10^{-3}	1.2×10^{-3}	3.2×10^{-3}	4.2×10^{-3}	8.8×10^{-2}
Total	8.1×10^{-1}	2.6×10^{-1}	4.3×10^{-1}	4.6×10^{-1}	3.1×10^{-1}	1.2×10^{-1}	2.4×10^0

Notes:

1. Average individual dose = 2.7×10^{-7} rem for the total population of 80-km radius area.
2. Total 80-km radius man-rem dose estimate from naturally occurring airborne radioactivity dose to the lung of ~ 0.1 rem/year = 1,000,000 (1.0×10^6) man-rem.

TABLE 17
POPULATION DOSE ESTIMATES FOR ATMOSPHERIC EMISSIONS
FROM SSFL FACILITIES -- 1983

22.5° Sector	Dose to Receptor Population Segment (man-rem)						
	0-8 km	8-16 km	16-32 km	32-48 km	48-64 km	64-80 km	Total
N	6.2×10^{-5}	1.4×10^{-7}	1.1×10^{-5}	1.8×10^{-6}	2.1×10^{-7}	2.0×10^{-8}	7.5×10^{-5}
NNW	2.5×10^{-5}	5.5×10^{-7}	6.1×10^{-7}	0	0	2.9×10^{-7}	2.6×10^{-5}
NW	6.8×10^{-5}	0	3.4×10^{-6}	0	4.7×10^{-8}	9.4×10^{-8}	7.2×10^{-5}
WNW	1.1×10^{-4}	6.4×10^{-6}	7.3×10^{-6}	7.1×10^{-6}	7.7×10^{-6}	0	2.6×10^{-4}
W	0	4.8×10^{-6}	1.6×10^{-5}	2.8×10^{-5}	1.1×10^{-5}	2.7×10^{-6}	6.2×10^{-5}
WSW	5.4×10^{-5}	3.7×10^{-5}	4.0×10^{-5}	6.1×10^{-7}	0	0	1.3×10^{-4}
SW	2.3×10^{-5}	0	0	0	0	0	2.3×10^{-5}
SSW	2.5×10^{-5}	0	0	0	0	0	2.5×10^{-5}
S	8.5×10^{-5}	0	0	0	0	0	8.5×10^{-5}
SSE	4.7×10^{-5}	0	0	0	0	0	4.7×10^{-5}
SE	3.1×10^{-5}	0	0	0	0	0	3.1×10^{-5}
ESE	2.3×10^{-4}	1.7×10^{-4}	2.4×10^{-4}	5.8×10^{-5}	0	0	7.0×10^{-4}
E	3.4×10^{-4}	7.9×10^{-4}	3.6×10^{-4}	2.0×10^{-4}	0	0	1.7×10^{-3}
ENE	5.6×10^{-4}	2.3×10^{-4}	1.4×10^{-4}	7.5×10^{-5}	0	0	1.0×10^{-3}
NE	4.5×10^{-4}	3.5×10^{-5}	2.8×10^{-9}	2.2×10^{-7}	0	0	4.8×10^{-4}
NNE	5.8×10^{-5}	8.6×10^{-6}	1.7×10^{-6}	1.6×10^{-5}	0	0	8.4×10^{-5}
Total	2.2×10^{-3}	1.3×10^{-3}	8.2×10^{-4}	3.9×10^{-4}	1.9×10^{-5}	3.1×10^{-6}	4.7×10^{-3}

Average individual dose = 5.9×10^{-10} rem for the 80-km radius area total population.

APPENDIX A
COMPARISON OF ENVIRONMENTAL RADIOACTIVITY DATA
FOR 1983 WITH PREVIOUS YEARS

This section compares environmental monitoring results for calendar year 1983 with previous annual data.

The data presented in Tables A-1 through A-5 summarize past annual average radioactivity concentrations. These data show the effects of both the short-lived and long-lived radioactive fallout from nuclear weapons tests superimposed on the natural radioactivity inherent in the various sample types.

Over the considerable period of time that the environmental program has been in operation, evolutionary changes have been made in order to provide more effective data. In some cases, this is readily apparent in the data. For example, in Table A-1, a small but abrupt increase in the alpha activity reported for soil occurs in 1971. This increase, which is observed in both the onsite and the offsite samples, resulted from use of an improved counting system with a thinner sample configuration. The thinner sample increases the sensitivity of the detector to alpha-emitting radionuclides in the sample, thus producing a higher measured specific radiation.

Similarly, prior to 1971, gross activity in ambient air was measured, including both alpha and beta activity. In 1971, measurements were begun which allowed separate identification of these two types of radiation.

For all types of samples, the data indicate that there is no concentrated local source of unnatural radioactivity in the environment. Also, the similarity between onsite and offsite results further indicates that ESG operations contribute essentially nothing to general environmental radioactivity.

TABLE A-1
SOIL RADIOACTIVITY DATA — 1964 THROUGH 1983

Year	Onsite Average (10^{-6} μ Ci/g)			Offsite Average (10^{-6} μ Ci/g)		
	Number of Samples	α	β	Number of Samples	α	β
1983	144	0.61	24	48	0.59	23
1982	144	0.69	25	48	0.68	23
1981	144	0.69	25	48	0.64	23
1980	144	0.60	24	48	0.58	23
1979	144	0.64	25	48	0.50	23
1978	144	0.63	24	48	0.51	24
1977	144	0.56	24	48	0.53	23
1976	144	0.56	25	48	0.56	24
1975	144	0.60	25	48	0.58	24
1974	144	0.60	25	48	0.54	24
1973	144	0.57	25	48	0.51	24
1972	144	0.56	25	48	0.57	24
1971	144	0.55	25	48	0.53	23
1970	144	0.47	27	48	0.48	25
1969	144	0.42	27	48	0.42	25
1968	144	0.47	26	48	0.48	26
1967	144	0.42	28	48	0.39	24
1966	144	0.41	29	48	0.44	25
1965	144	0.46	36	142	0.47	29
1964	152	0.46	32	299	0.44	26

TABLE A-2
VEGETATION RADIOACTIVITY DATA — 1964 THROUGH 1983

Year	Onsite Average (10^{-6} μ Ci/g ash)			Offsite Average (10^{-6} μ Ci/g ash)		
	Number of Samples	α	β	Number of Samples	α	β
1983	144	0.18	149	48	0.24	143
1982	144	0.16	140	48	0.17	130
1981	144	< 0.20	137	48	< 0.21	129
1980	144	< 0.25	150	48	< 0.19	142
1979	144	< 0.24	139	48	< 0.23	134
1978	144	< 0.24	166	48	< 0.24	143
1977	144	< 0.22	162	48	< 0.21	142
1976	144	< 0.19	170	48	< 0.22	147
1975	144	< 0.21	155	48	< 0.21	141
1974	144	< 0.20	152	48	< 0.27	141
1973	144	< 0.24	155	48	< 0.24	142
1972	144	0.23	145	48	0.36	125
1971	144	0.24	165	48	0.31	132
1970	144	0.33	159	48	0.30	142
1969	144	0.40	165	48	0.36	144
1968	144	0.51	158	48	0.51	205
1967	144	0.62	286	48	0.39	413
1966	144	0.37	169	48	0.37	123
1965	144	0.56	162	142	0.61	138
1964	154	0.50	211	293	0.51	181

TABLE A-3
 SSFL SITE DOMESTIC WATER RADIOACTIVITY DATA —
 1964 THROUGH 1983

Year	Number of Samples	Average α (10^{-9} μ Ci/ml)	Average β (10^{-9} μ Ci/ml)
1983	24	0.12	3.0
1982	24	0.14	3.0
1981	24	<0.24	2.8
1980	24	<0.22	2.4
1979	24	<0.23	2.8
1978	24	<0.26	3.0
1977	24	<0.25	2.5
1976	24	<0.25	2.0
1975	24	<0.24	2.3
1974	24	<0.24	2.7
1973	24	<0.26	3.4
1972	24	0.22	3.7
1971	24	0.28	4.9
1970	24	0.18	5.3
1969	24	0.11	5.0
1968	24	0.16	5.0
1967	24	0.13	6.1
1966	24	0.13	4.6
1965	24	0.22	6.0
1964	23	0.18	5.3

TABLE A-4
BILL CRILK AND ROCKFORD DIVISION RETENTION POND RADIOACTIVITY DATA 1966 THROUGH 1983

Year	Samples														
	Bell Creek Mud 54			Bell Creek Vegetation 54			Bell Creek Water 16			Interim Retention Pond Water 6			Final Retention Pond R-2A Water 12		
	Number of Samples	Average (10 ⁻⁶ µCi/g)		Number of Samples	Average (10 ⁻⁶ µCi/g ash)		Number of Samples	Average (10 ⁻⁹ µCi/ml)		Number of Samples	Average (10 ⁻⁹ µCi/ml)		Number of Samples	Average (10 ⁻⁹ µCi/ml)	
1983	12	0.54	23.	12	0.12	136.	12	0.08	3.3	12	0.12	3.6	12	0.13	4.4
1982	12	0.64	25.	12	0.08	160.	12	0.03	3.3	12	0.17	3.9	12	0.11	3.9
1981	12	0.58	24.	12	<0.13	103.	12	<0.23	3.8	12	<0.23	4.3	12	<0.25	5.2
1980	12	0.51	23.	12	<0.18	150.	12	<0.22	2.9	12	<0.22	2.9	12	<0.22	3.9
1979	12	0.46	23.	12	<0.26	136.	12	<0.23	3.2	12	<0.25	3.1	12	<0.23	4.5
1978	12	0.42	23.	12	<0.26	156.	12	<0.24	2.5	12	<0.25	4.3	12	<0.25	4.6
1977	12	0.29	22.	12	<0.19	155.	12	<0.24	1.8	12	<0.24	4.3	12	<0.25	5.2
1976	12	0.38	23.	12	<0.17	164.	12	<0.25	2.2	12	<0.24	4.3	12	<0.28	4.4
1975	12	0.29	22.	12	<0.19	123.	12	<0.22	2.4	12	<0.24	4.2	12	<0.31	4.5
1974	12	0.32	22.	12	<0.16	142.	12	<0.21	2.5	12	<0.22	4.2	12	<0.21	4.5
1973	12	0.34	24.	12	<0.17	147.	12	<0.21	2.7	12	<0.23	4.5	12	<0.37	5.6
1972	12	0.32	22.	12	0.12	139.	12	0.20	2.5	12	0.22	5.3	12	0.22	5.5
1971	12	0.36	23.	12	0.19	128.	12	0.15	3.8	12	0.18	6.2	12	0.16	6.4
1970	12	0.44	24.	12	0.23	165.	12	0.15	3.7	12	0.15	6.9	12	0.12	7.4
1969	12	0.35	27.	12	0.28	166.	12	0.04	4.0	12	0.07	5.9	11	0.10	5.7
1968	11	0.32	24.	11	0.39	170.	8	0.05	4.6	11	0.23	8.1	12	0.33	7.7
1967	12	0.40	24.	12	0.38	180.	12	0.07	5.8	12	0.19	6.6	10	0.17	7.0
1966	3	0.39	25.	3	1.1	108.	3	0.75	2.5	9	0.11	5.8	8	1.1	6.3

TABLE A-5
 AMBIENT AIR RADIOACTIVITY CONCENTRATION DATA —
 1964 THROUGH 1983

Year	De Soto Site Average (10 ⁻¹² μCi/ml)			SSFL Site Average ^a (10 ⁻¹² μCi/ml)		
	Number of Samples	α	β	Number of Samples	α	β
1983	644	0.0024	0.026	2328	0.0010	0.023
1982	727	0.0017	0.026	2347	0.0013	0.022
1981	704	<0.0069	<0.12	2518	<0.0068	<0.12
1980	685	<0.0065	<0.039	2342	<0.0064	<0.035
1979	697	<0.0066	<0.021	2519	<0.0065	<0.020
1978	713	<0.0084	<0.091	2402	<0.0072	<0.088
1977	729	<0.0066	<0.17	2438	<0.0066	<0.17
1976	719	<0.0067	<0.096	2520	<0.0065	<0.11
1975	709	<0.0063	<0.076	2450	<0.0060	<0.073
1974	663	<0.0056	<0.16	2477	<0.0057	<0.16
1973	715	<0.0075	<0.041	2311	<0.0072	<0.038
1972	708	0.0085	0.14	2430	0.0086	0.14
1971 ^b	730	0.0087	0.30	2476	0.0086	0.33
1970	668	-	0.34	2434	-	0.36
1969	687	-	0.27	2364	-	0.26
1968	650	-	0.32	2157	-	0.32
1967	712	-	0.39	2400	-	0.41
1966	706	-	0.18	2205	-	0.17
1965	483	-	0.83	1062	-	0.21
1964	355	-	2.7	-	-	c

^aIncludes Rocketdyne Site Air Sampler Data

^bAmbient air alpha radioactivity values were included in the beta values and not reported separately prior to 1971

^cInsufficient data

APPENDIX B
ENVIRONMENTAL MONITORING PROGRAM QUALITY CONTROL

This section describes the quality assurance (QA) elements that are incorporated into the ESG program to ensure that data produced are as meaningful as possible.

PROCEDURES

Procedures are followed that include sample selection; sample collection; packaging, shipment, and handling of samples for offsite analysis; preparation and analysis of samples; use of radioactive reference standards; calibration methods and instrument QA; and evaluation and reporting of data.

RECORDS

Records generally cover the following processes: field sample collection and laboratory identification coding; sample preparation method; radioactivity measurements (counting) of samples, instrument backgrounds, and analytical blanks; and data reduction and verification.

Quality control records for laboratory counting systems include the results of measurements of radioactive check sources, calibration sources, backgrounds, and blanks, as well as a complete record of all maintenance and service.

Records relating to overall laboratory performance include the results of analysis of quality control samples such as analytical duplicates, inter-laboratory cross-check samples, and other quality control analyses; use of standard (radioactive) reference materials to prepare working standards; and calibration of analytical balances.

The following specific elements of quality control are used for the ESG program:

- 1) Reagent Quality - Reagent-grade chemicals and certified grade counting gas are used.
- 2) Laboratory Ventilation - Room air supply is controlled to minimize temperature variance and dust incursion.
- 3) Laboratory Contamination - Periodic laboratory contamination surveys for fixed and removable surface contamination are performed. Areas are cleaned routinely and decontaminated when necessary.
- 4) Control Charts - Background and reference source control charts for counting equipment are maintained to evaluate stability and response characteristics.
- 5) Laboratory Intercomparisons - ESG participates in the DOE-EML Laboratory Quality Assessment Program, and also participates in the DOE Environmental Dosimeter Intercomparison Project.
- 6) Duplicate Samples - Duplicate samples are obtained monthly at randomly selected environmental sampling locations. Analytical data are statistically evaluated to determine the correlation coefficients for each media type for the annual sample set.
- 7) Calibration Standards - Counting standard radioactivity values are traceable to National Bureau of Standards primary standards.

APPENDIX C

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD CRITERIA FOR
DISCHARGING NONRADIOACTIVE CONSTITUENTS FROM ROCKETDYNE DIVISION, SSFL

The discharge of an effluent in excess of the limits given in Table C-1 is prohibited.

TABLE C-1
NPDES NO. CA00-01309, EFFECTIVE 27 SEPTEMBER 1976

Constituent	Discharge Rate (lb/day)	Concentration Limit (mg/liter)	
	30-day Average	30-day Average	Maximum
Total dissolved solids	1,267,680	-	950
Chloride	200,160	-	150
Sulfate	400,320	-	300
Suspended solids ^a	66,720	50	150
Settleable solids ^a	-	0.1	0.3
BOD ₅	26,690	20	60
Oil and grease	13,350	10	15
Chromium	6.67	0.005	0.01
Fluoride	1,340	-	1.0
Boron	1,340	-	1.0
Residual chlorine	-	-	0.1
Fecal coliform (MPN/100 ml)	-	-	23.0 ^b
Surfactants (as MBAS)	667	-	0.5
pH			6.0-9.0

^a Not applicable to discharges containing rainfall runoff during or immediately after periods of rainfall.

^b Wastewater shall be considered adequately disinfected if the median number of coliform organisms does not exceed 23 per 100 ml.

APPENDIX D
REFERENCES

1. DOE Order 5484.1
2. DOE Order 5480.1A
3. Code of Federal Regulations, Title 10, Part 20
4. California Radiation Control Regulations, California Administrative Code, Title 17, Public Health
5. California Regional Water Quality Control Board, Los Angeles Region, Order No. 74-379, NPDES No. CA0001309, Effective 27 September 1976
6. AIRDOS-EPA: A Computerized Methodology for Estimating Environmental Concentrations and Doses to Man from Airborne Releases of Radionuclides, ORNL-5532
7. Estimates of Internal Dose Equivalent to 22 Target Organs for Radionuclides Occurring in Routine Releases from Nuclear Fuel Cycle Facilities, Volume III, ORNL/NUREG/TM-190

APPENDIX E
EXTERNAL DISTRIBUTION

1. Radiologic Health Section, Department of Health Services, California
2. Radiation Management, Health Services Department, Los Angeles County, California
3. Resources Management Agency, County of Ventura, California
4. U.S. Nuclear Regulatory Commission, Division of Reactor Licensing
5. U.S. Department of Energy, San Francisco Operations Office
6. U.S. Department of Energy, Office of Operational Safety, EP-32, Technical Information Center.

779-C-3/glb