


# WHERE HAVE WE SAMPLED GROUNDWATER FOR TRITIUM?



## Explanation

- Property Boundary Line
- Red indicates tritium above 20,000 pCi/l
- Orange indicates tritium between 1,000 and 20,000 pCi/l
- Blue indicates tritium below 1,000 pCi/l

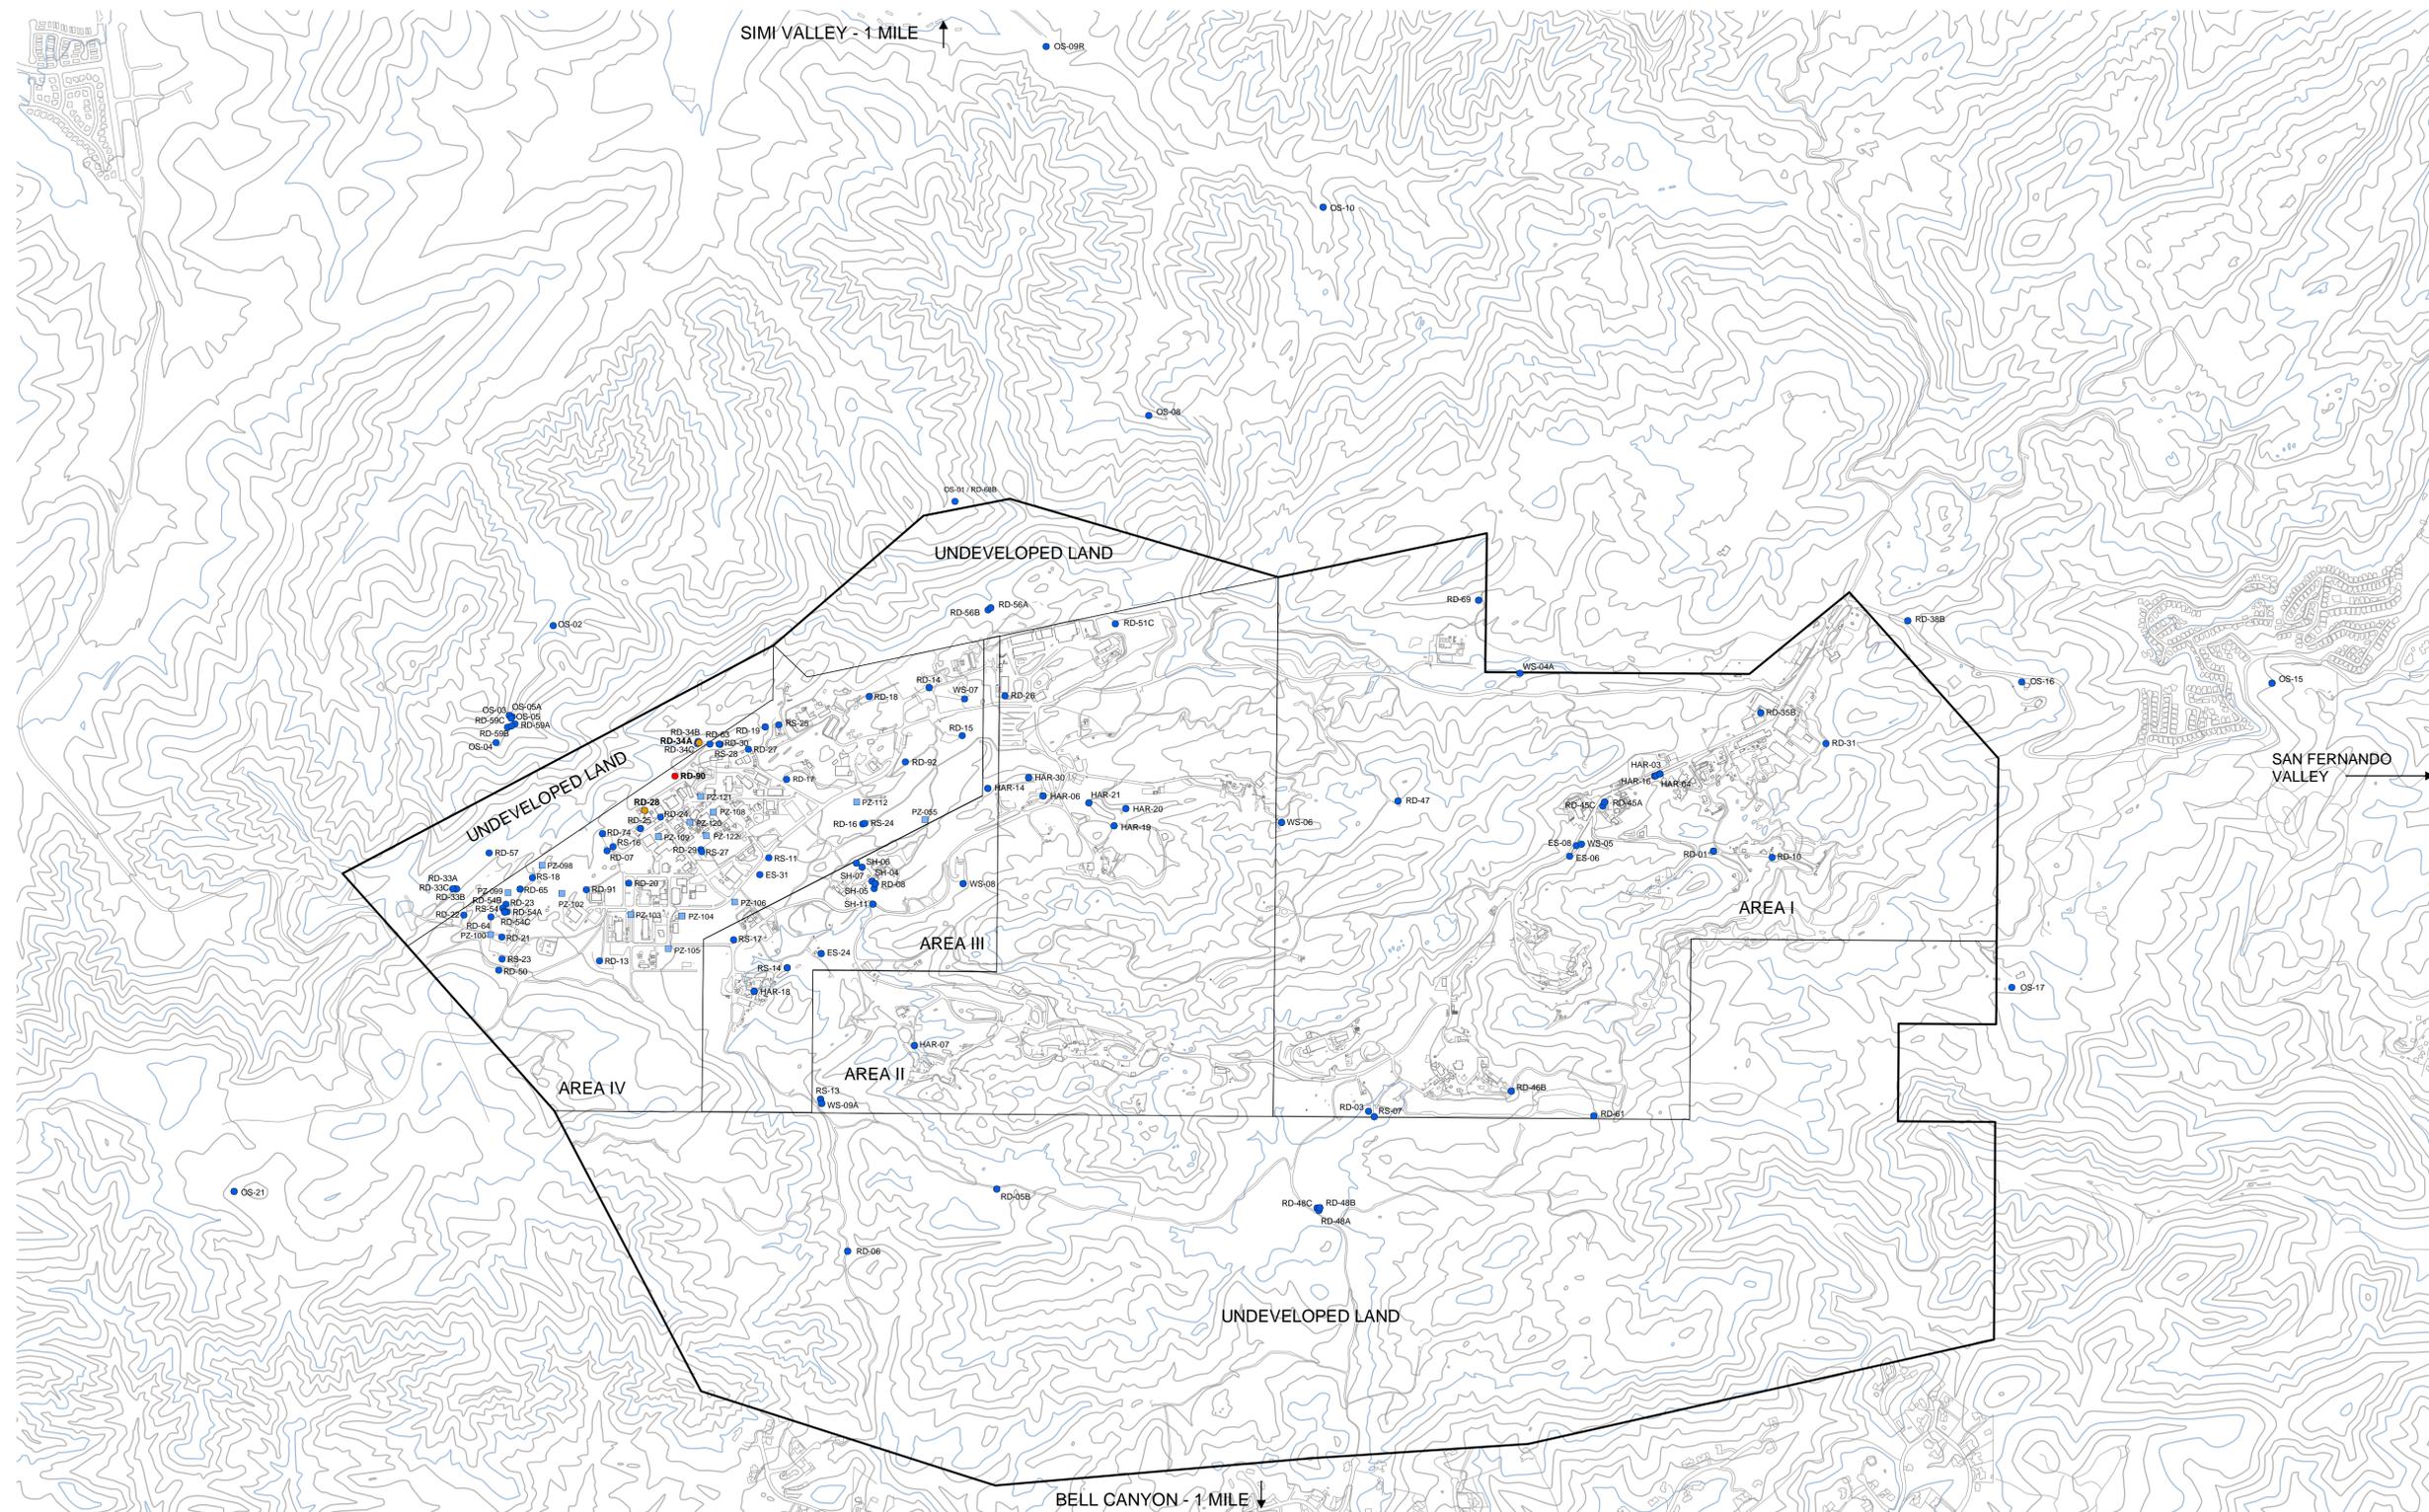

0 800 1,600 3,200 Feet



THE BOEING COMPANY  
ROCKETDYNE PROPULSION & POWER  
SANTA SUSANA FIELD LABORATORY

## TRITIUM IN GROUNDWATER

UNDERGROUND  
ENGINEERING &  
ENVIRONMENTAL  
SOLUTIONS

SCALE AS SHOWN

JUNE 2004

FIGURE 1